
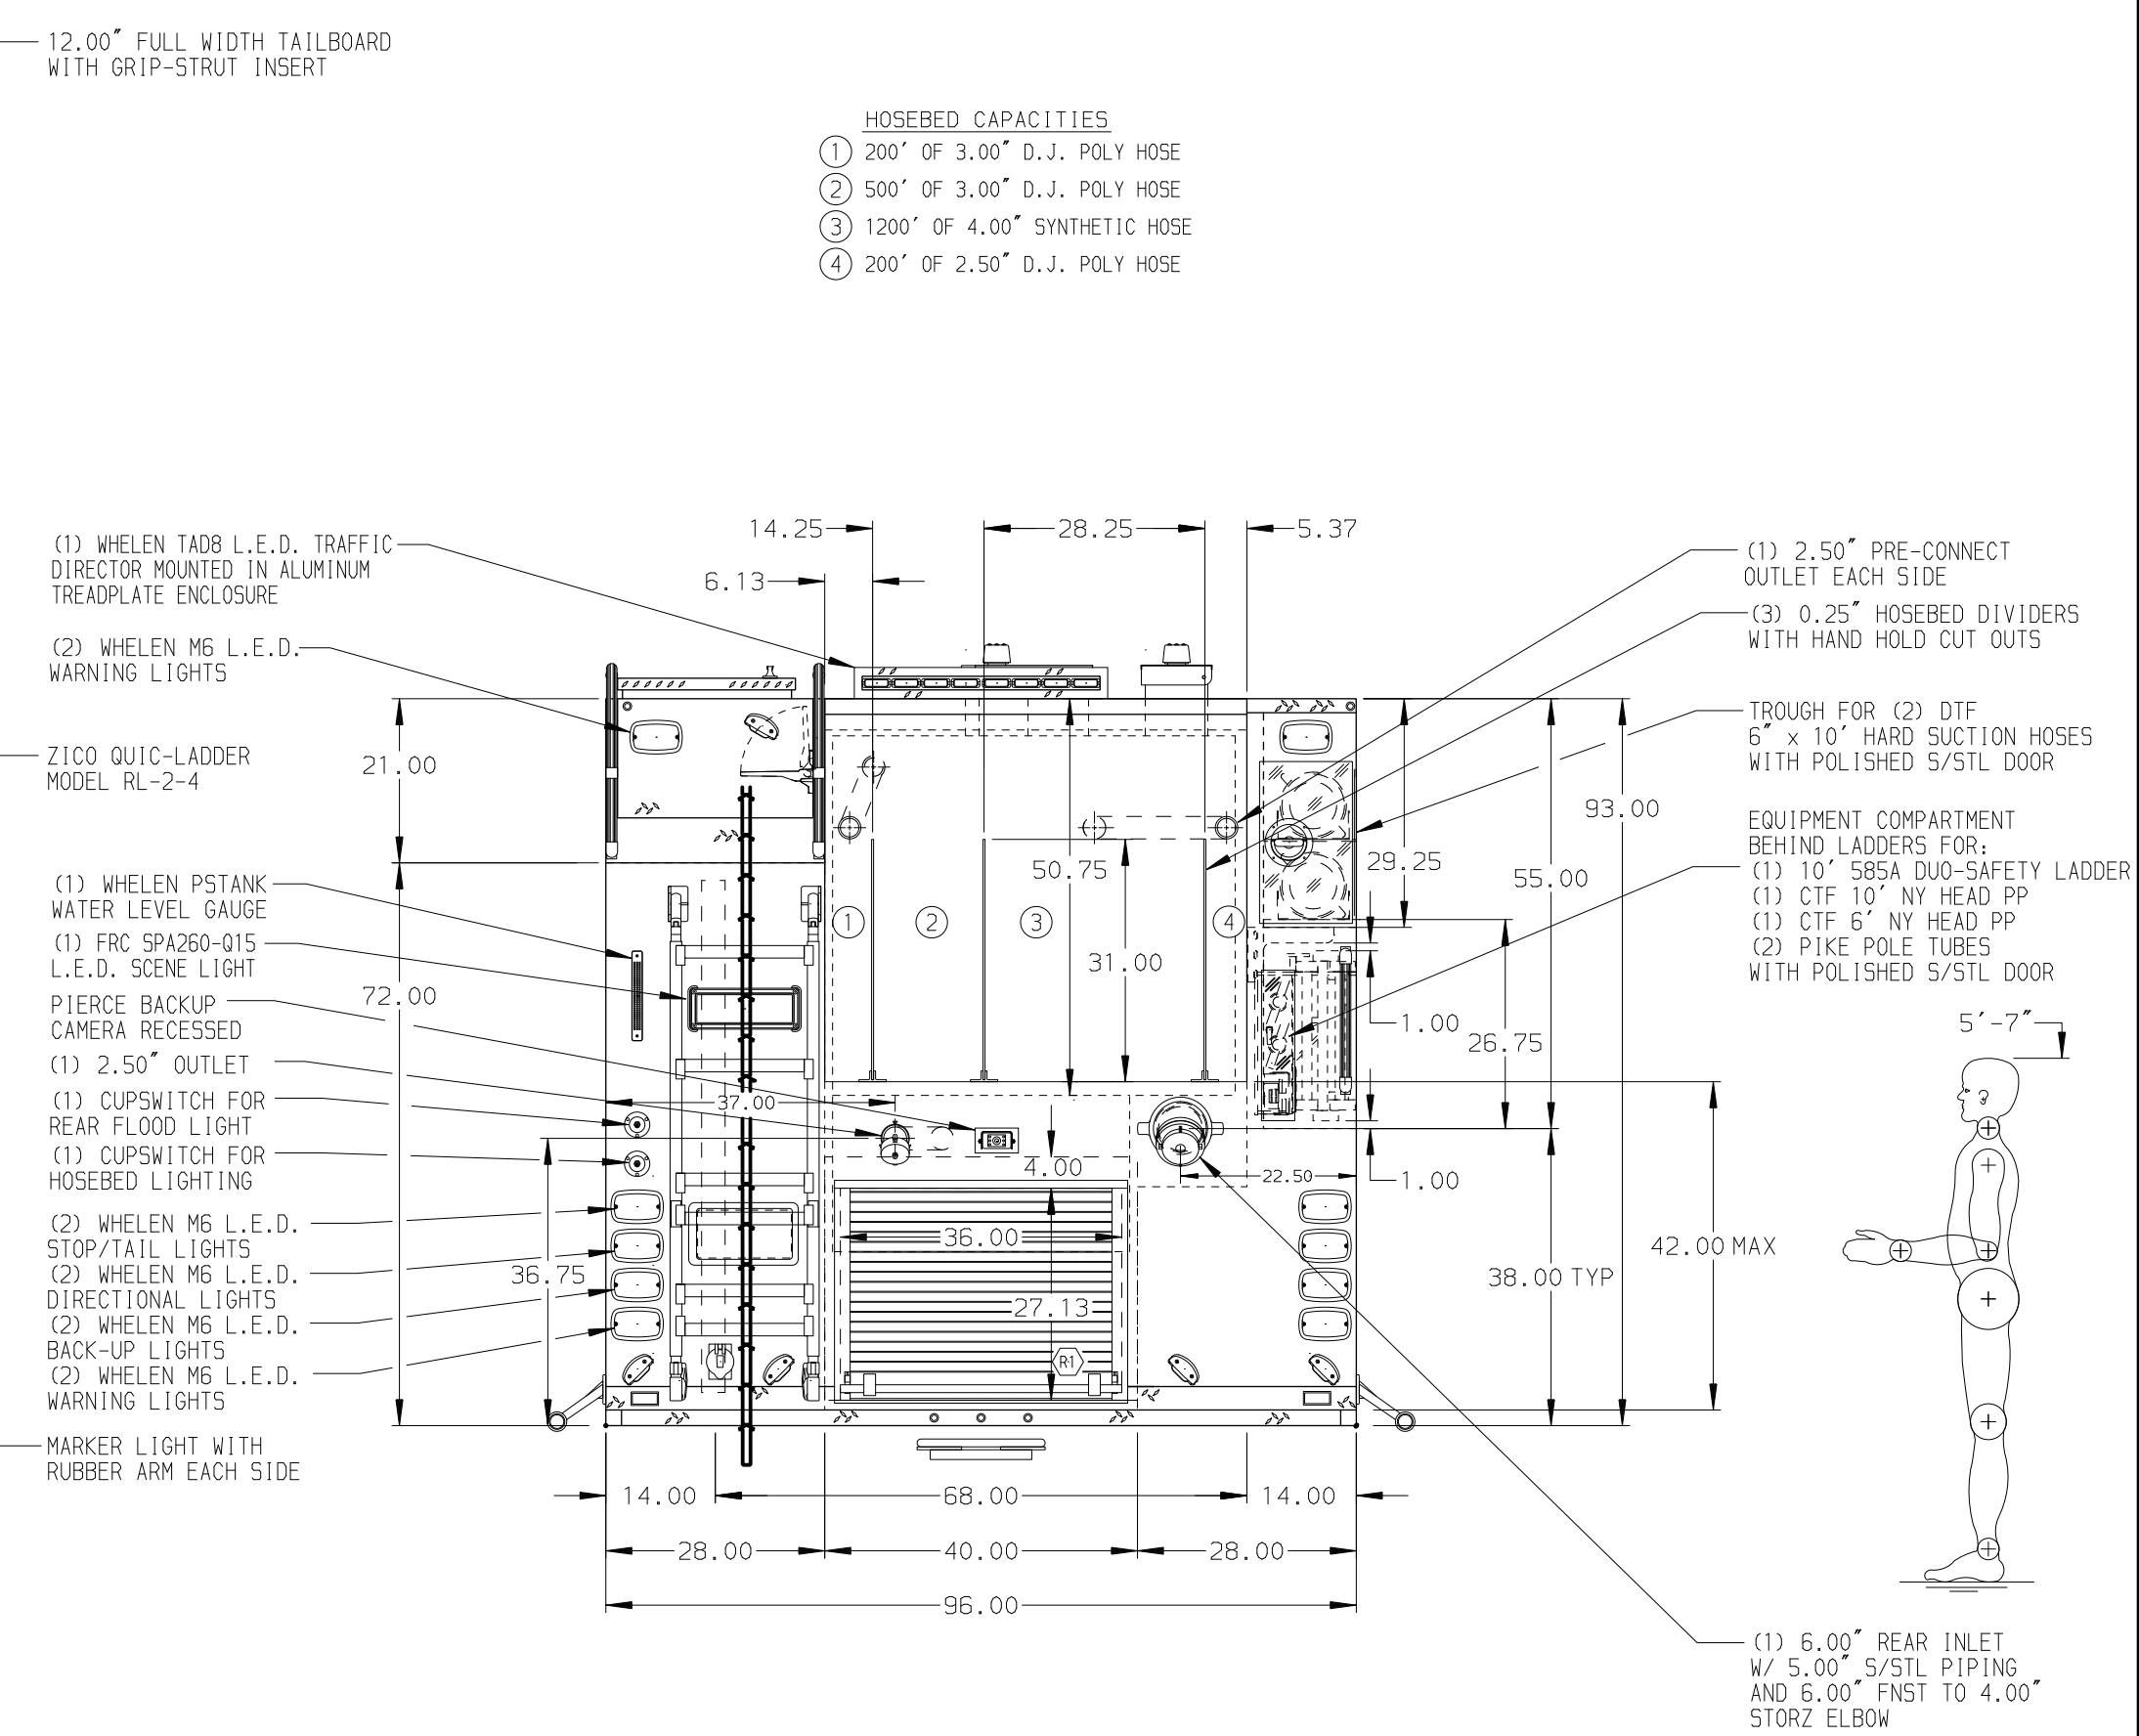


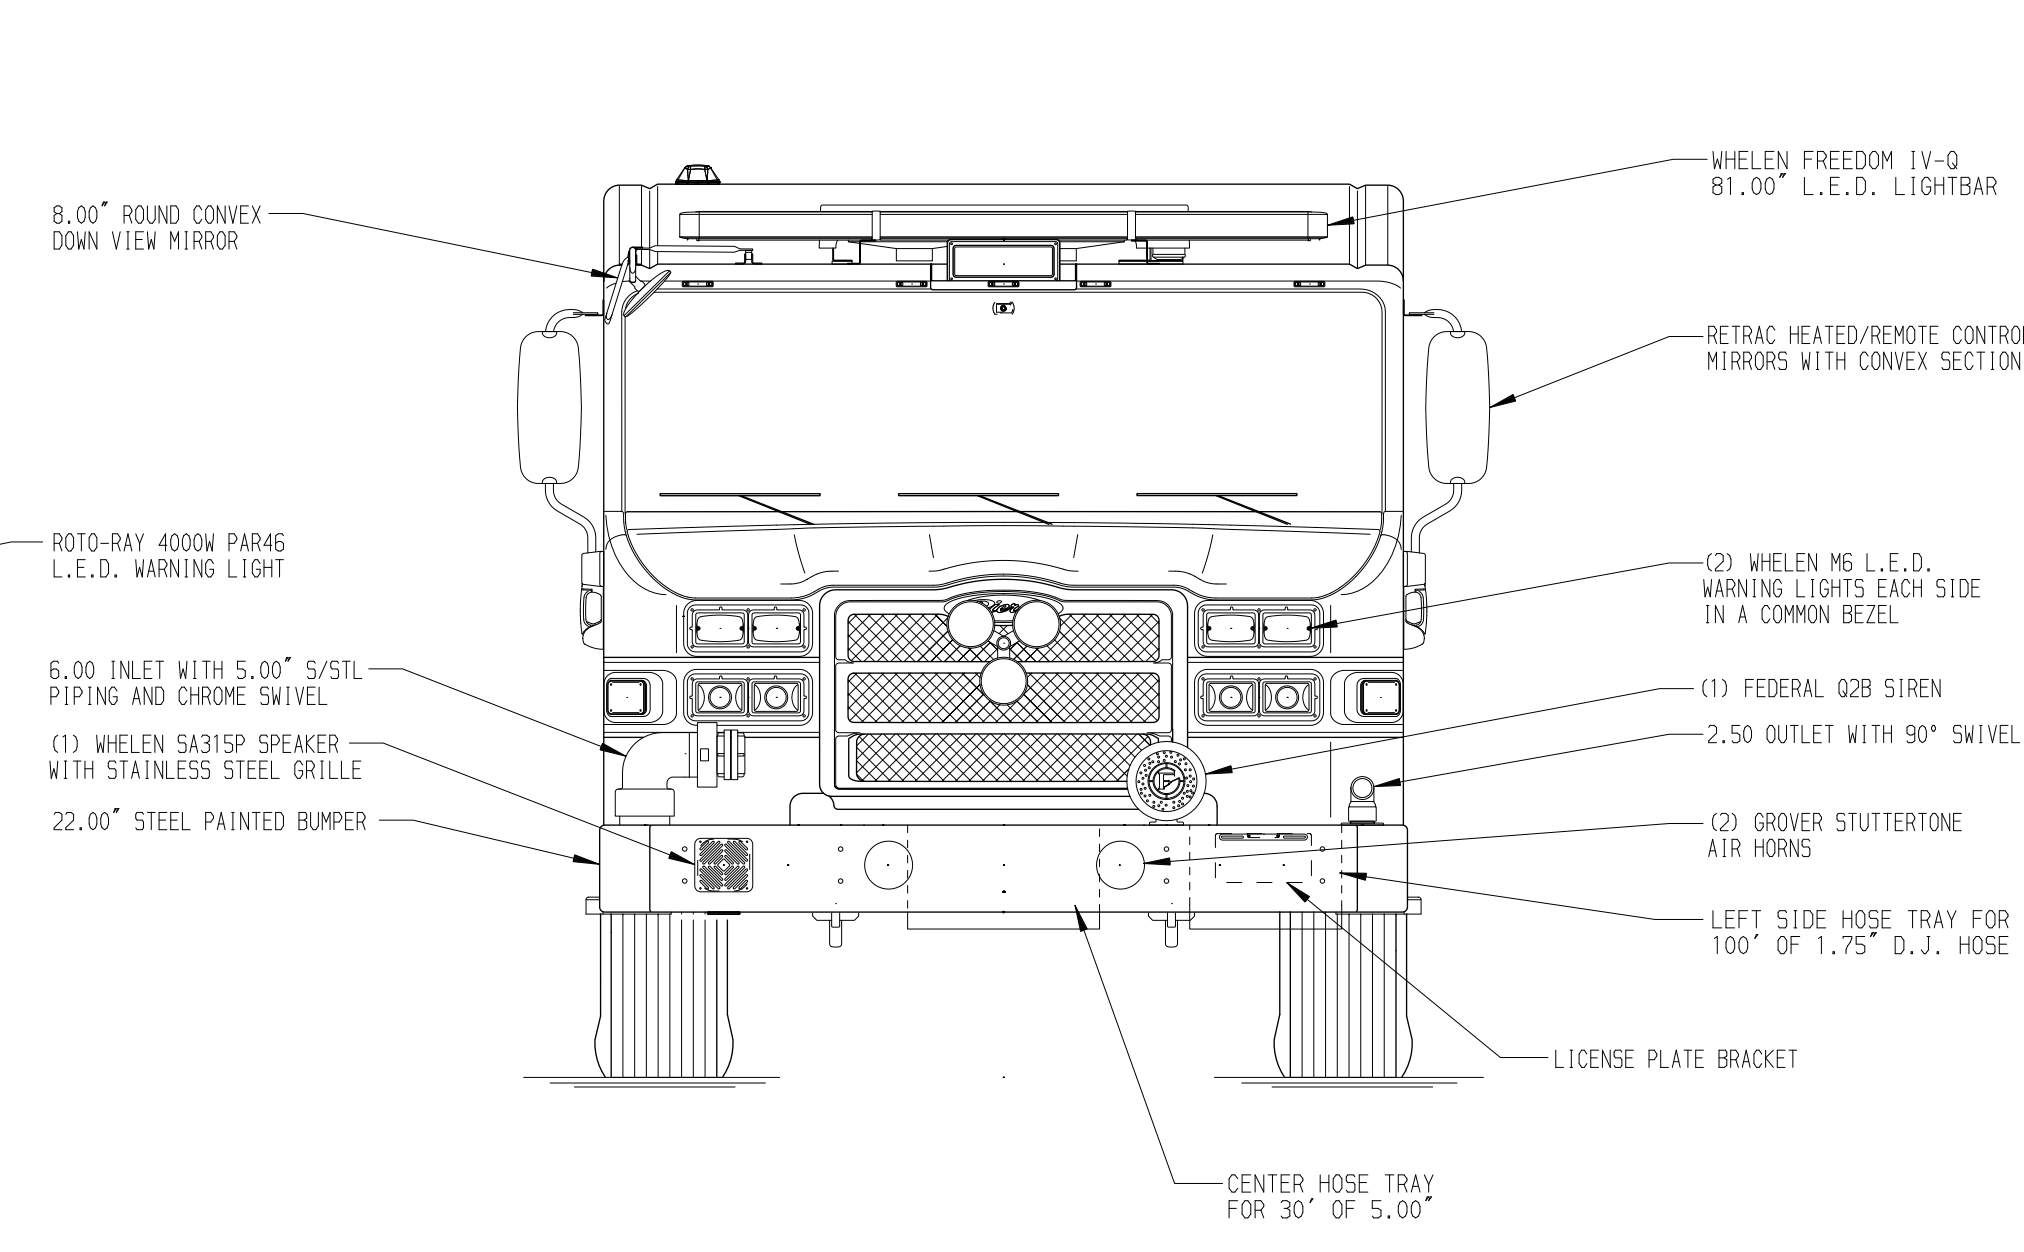

(SIDE ROLL PROTECTION)
(FRONTAL IMPACT PROTECTION)

1. ONSPOT AUTOMATIC TIRE CHAINS TO BE PROVIDED AT REAR	11. PARTITION BETWEEN COMPARTMENTS P1/R1
2. CIRCUIT BREAKER PANEL IN COMPARTMENT D3	12. ONE SENTREX 6-PLACE RECEPTACLE STRIP IN EACH EMS COMPARTMENT
3. BATTERY CHARGER LOCATED IN COMPARTMENT D3	13. AIR INLET/OUTLET WITH DISCONNECT FITTING ON D3 PUMP PANEL
4. DUAL L.E.D. LIGHT FIXTURES IN D3	14. THREE STORAGE RACKS FOR FIRE EXTINGUISHERS IN D2 W/ 10" SLANT TOWARDS BACK WALL
5. REVERSED HINGED DOOR ON COMPARTMENTS D3 & P2	15. AMOR LUMBAR H20 L.E.D. LIGHTING IN CARGO AREA
6. TWO ADJ. SHELVE'S W/ SPC. WALL HEIGHTS IN D1 & (1) IN P2	16. ONE 15/20A 120V RECEPTACLE TO BE INSTALLED HIGH & RIGHT ON BACK WALL IN COMPARTMENT R1
7. TWO ADJ. SLIDE-OUT TRAYS W/ 2" SIDES IN D3	17. SPECIAL REARERS TO BE INSTALLED ON TILT-OUT TRAYS
8. ONE TILT / SLIDE-OUT 30" TRAYS IN D1, D2, & D3	
9. ONE SLIDE-OUT TOOLBOARD W/ PEGBOARD IN D1	
10. ONE VERTICAL DIVIDER TO BE INSTALL IN D1	

 MANUFACTURING INC.		JOB NO.	31590
		SCALE 1:24	DATE
TITLE	1500-D-750P, (2) 40 GAL FOAM CELLS, 152" PUMPER BODY (3) CROSSLAYS, HALE PUMP MODULE, NEW YORK STYLE TANK		DRAWN BY GVH
FOR	STONEWALL JACKSON VOL. FIRE DEPARTMENT MANASSAS, PRINCE WILLIAM COUNTY, VIRGINIA		CHECKED BY WKL
DWG NO.	31590AD		SHEET NO. 1 OF 1