


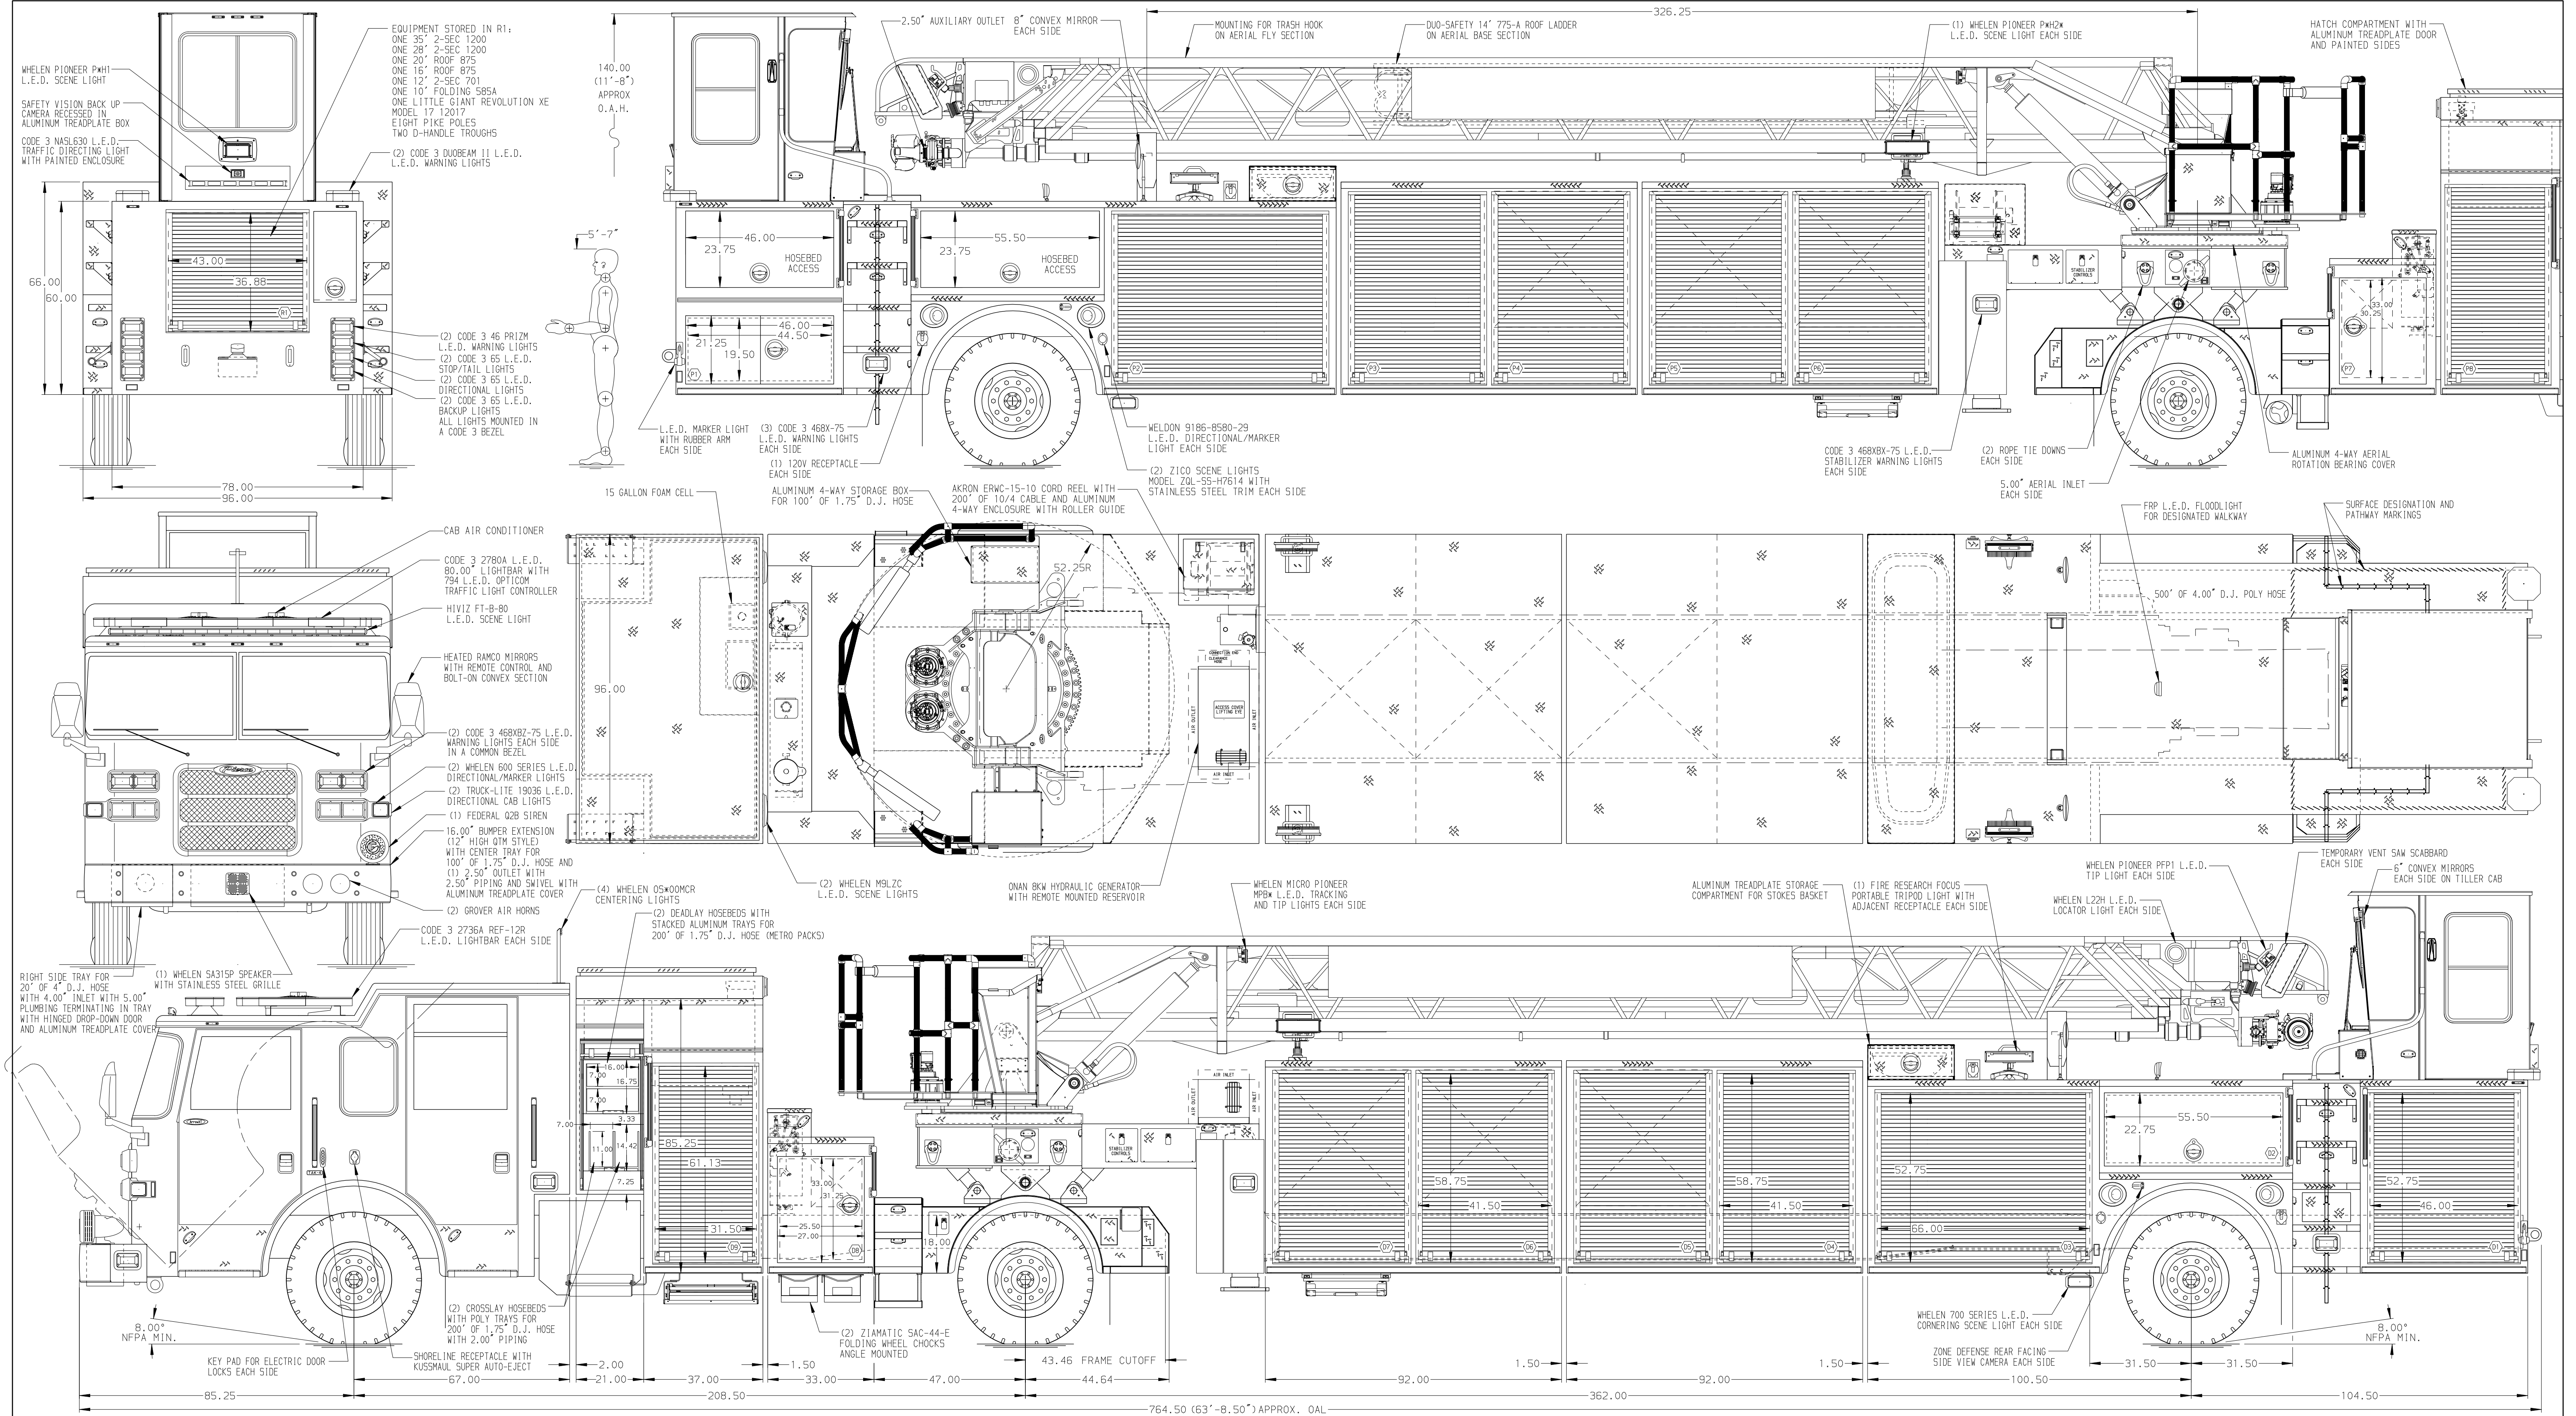

ALUMINUM BODY

MAXIMUM O.A.H. 142.00"

NOTE

DIMENSIONS SHOWN ARE APPROXIMATE AND ARE SUBJECT TO MINOR DEVIATIONS AS MAY OCCUR OR BE NECESSARY IN CONSTRUCTION. MINOR DETAILS NOT SHOWN.

- BATTERY CHARGER LOCATED IN COMPARTMENT P6
- BATTERY CHARGE INDICATOR LOCATED NEAR DRIVER'S SEAT RISER WITH BRACKET
- ONE FULL WIDTH/DEPTH ADJUSTABLE SHELF IN COMPARTMENTS D1,D3,D7,D8,D7,TWO IN P8,THREE IN D4,P2,P3
- ONE ADJUSTABLE SLIDE-OUT TRAY (1/2 DEPTH OF TRANSVERSE) IN COMPARTMENT D7,TWO IN D5,P4
- ONE FLOOR MOUNTED 1-WAY SLIDE-OUT TRAY WITH 3" SIDES (1/2 TRANSVERSE DEPTH) IN COMPARTMENTS D6,P5
- ONE CTECH 3-DRAWER ASSEMBLY IN COMPARTMENT D7
- ONE FLOOR MOUNTED 1-WAY SLIDE-OUT TRAY WITH 3" SIDES (3/4 TRANSVERSE DEPTH) IN COMPARTMENT P6
- FLOOR EXTENSION WITH 1.00" UP/TURNED LIP IN COMPARTMENTS D6,P5,P6
- TWO AIR BOTTLE STORAGE TUBES WITH 7.5" DIAMETER - LOCATION TBD
- ONE 120V DUPLEX RECEPTACLE LOCATED IN COMPARTMENT P6

- ONE ADJUSTABLE TILTING SLIDE-OUT TRAY IN COMPARTMENT D3
- ONE ADJUSTABLE TILTING SLIDE-OUT TRAY 1/2 TRANSVERSE DEPTH IN COMPARTMENTS D6,P5
- CIRCUIT BREAKER PANEL IN COMPARTMENT D7
- HUSKY 3 FOAM SYSTEM RESERVOIR LOCATED IN PUMP HOUSE
- TRIDENT FOLDING STEPS ON AERIAL DEVICE
- 120V POWER TO AERIAL TIP
- L.E.D. LIGHTING ON AERIAL LADDER SECTIONS
- 2-WAY INTERCOM SYSTEM BETWEEN AERIAL TIP AND TURNABLE
- LIFTING EYE ROPE RESCUE ATTACHMENT AT AERIAL TIP
- LYFEPULLEY RESCUE SYSTEM WITH WINCH AND PAINTED STORAGE BOX AT BASE SECTION

- CAB LIFT MANUAL OVERRIDE LOCATED ON DRIVER'S SIDE PUMP PANEL
- AIR INLET/OUTLET WITH DISCONNECT FITTING IN COMPARTMENT D9
- ZONE DEFENSE SIDE VIEW CAMERA LOCATED ON PASSENGER'S SIDE OF CAB
- 5/8" DRIP PAN/GUARD FOR EACH ROLL-UP DOOR
- 9.50" RAISED BOOM SUPPORT

REV	DATE	BY	CH	ARROW-XT
1	20JUN18	SHU	LPA	MAKE
2	24MAY18	SHU	LPA	PIERCE
3	09MAR18	SHU	JBL	MODEL

Pierce MANUFACTURING INC.		JOB NO.	32153 01-02
		SCALE	1:24
		DATE	28FEB18
		DRAWN BY	SHU
		CHECKED BY	JBL
		SHEET SIZE	D
		SHEET NO.	1 OF 2

TITLE	107' ASCENDANT AERIAL TILLER AND BODY ASSY
FOR	315 GALLON TANK, 300 GALLONS WATER/15 GALLONS FOAM
FOR	RIVERSIDE CITY FIRE DEPARTMENT
FOR	RIVERSIDE, CA
DWG NO.	32153AD-SH1