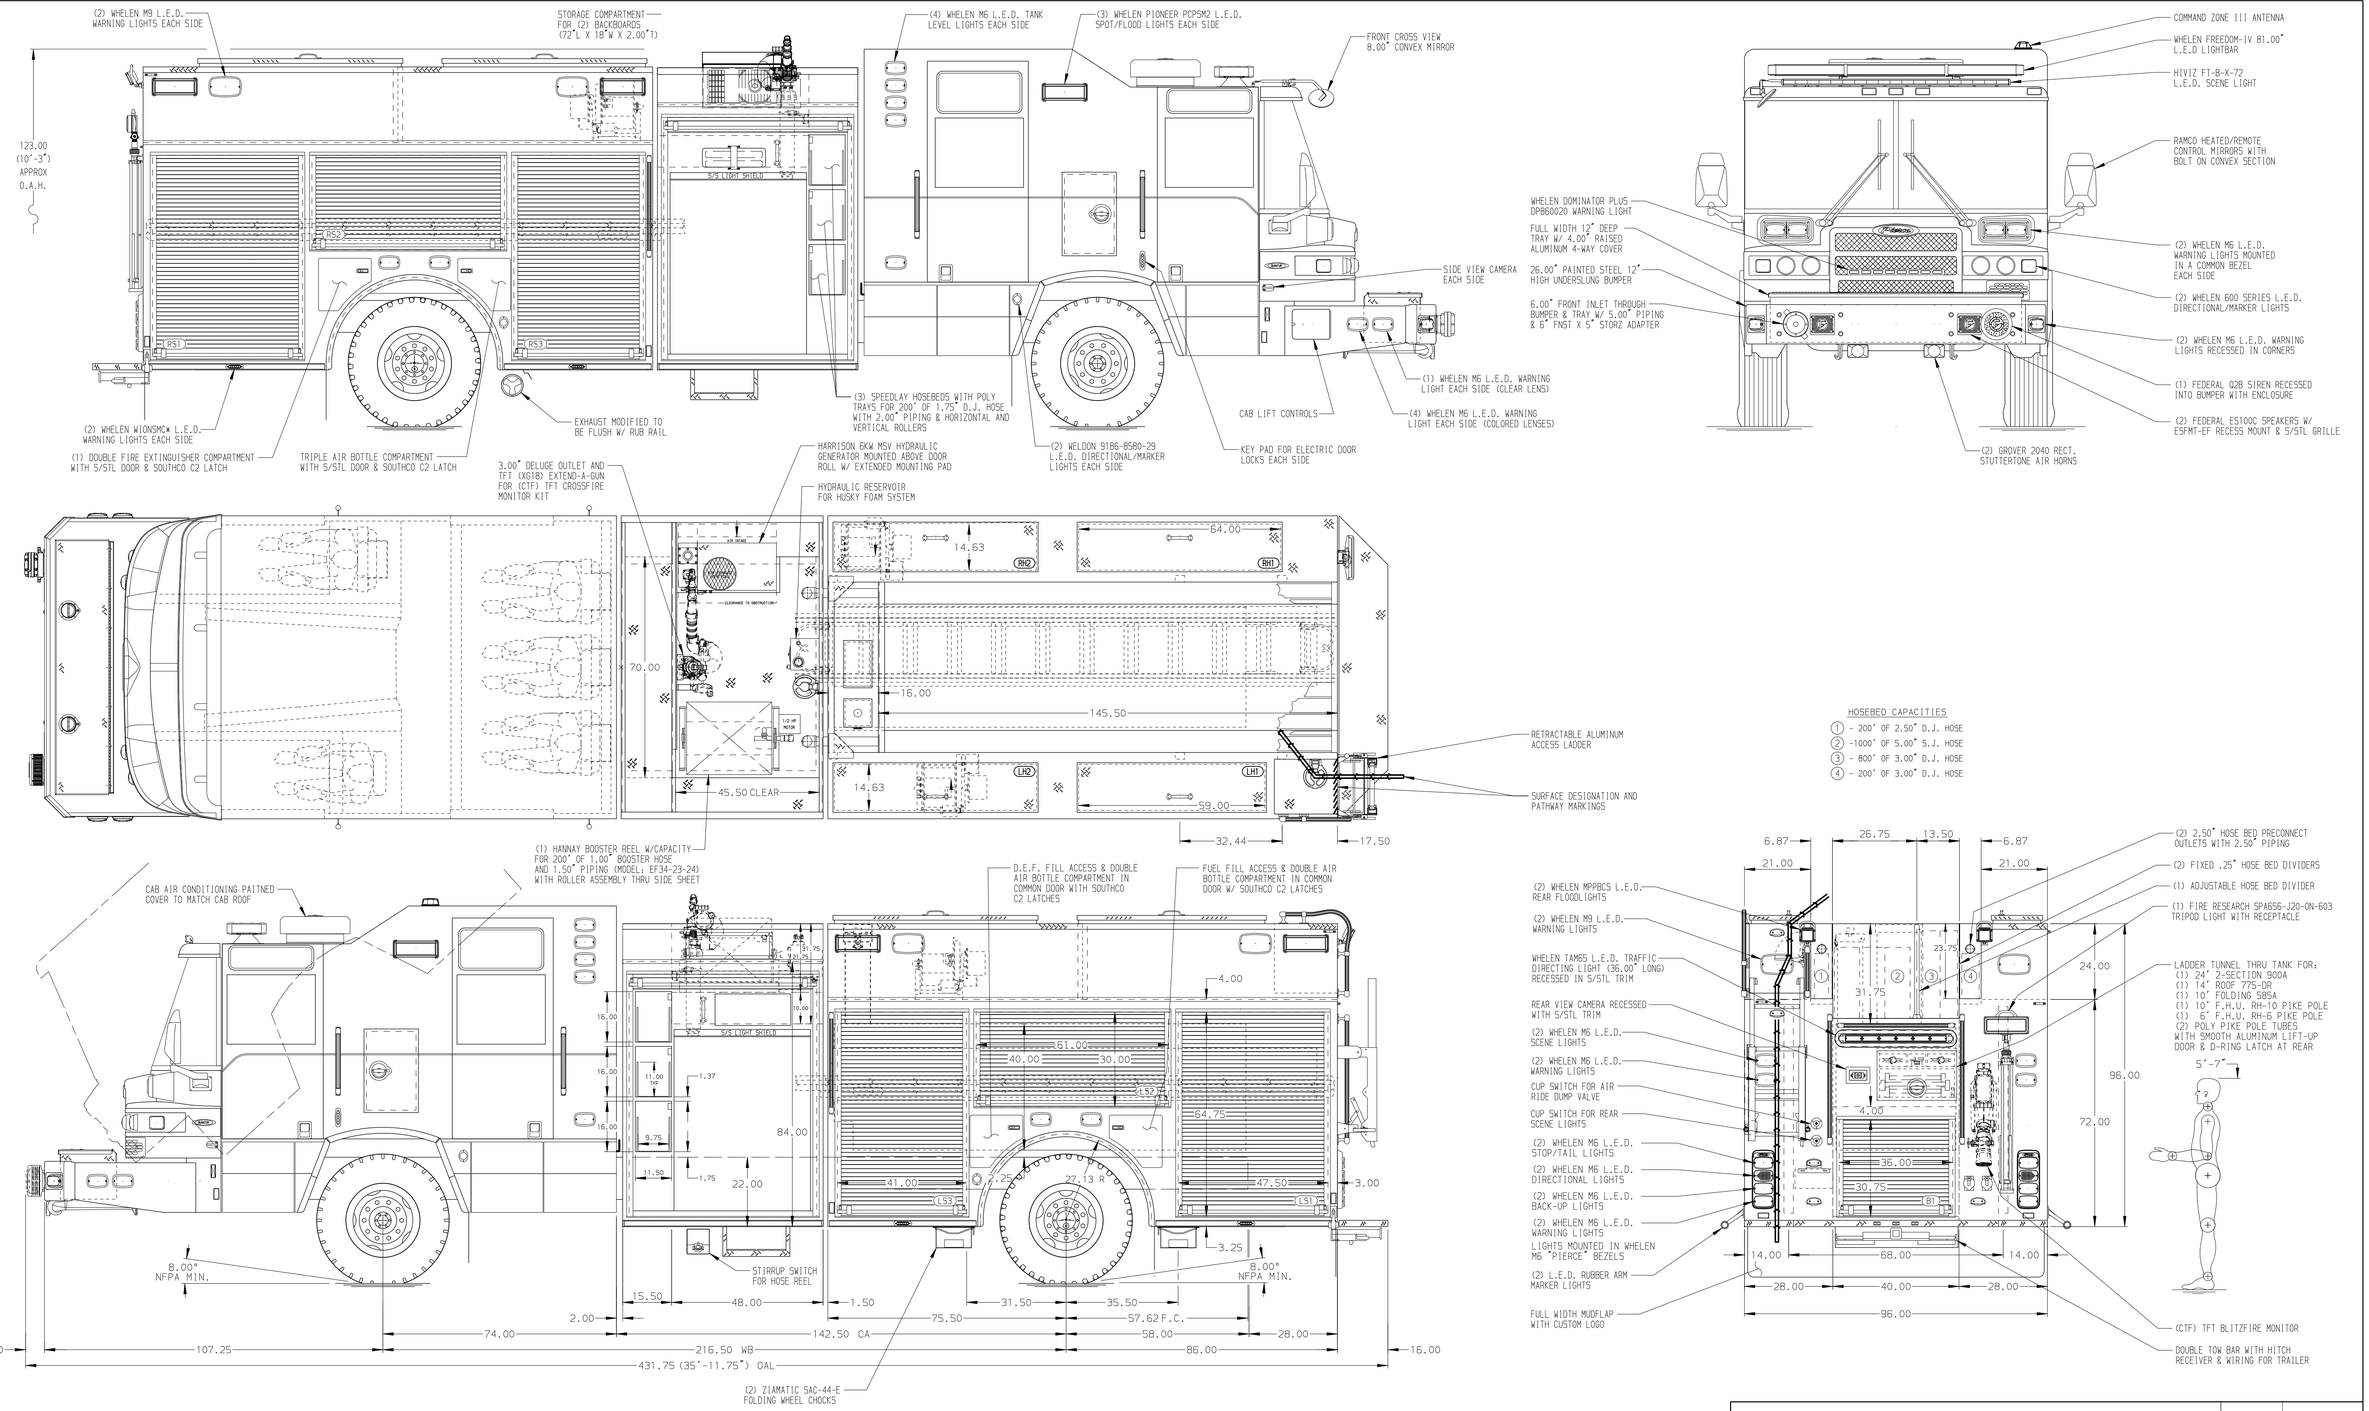

ALUMINUM BODY

SIDE ROLL AND FRONTAL IMPACT PROTECTION

NOTE

DIMENSIONS SHOWN ARE APPROXIMATE AND ARE SUBJECT TO MINOR DEVIATIONS AS MAY OCCUR OR BE NECESSARY IN CONSTRUCTION.
MINOR DETAILS NOT SHOWN.

1. AIR OUTLET WITH SHUT-OFF VALVE LOCATED ON RS PUMP PANEL
2. AIR INLET W/ DISCONNECT COUPLING LOCATED ON DRIVER'S SEAT RISER
3. BATTERY CHARGER LOCATED IN COMPARTMENT LS3.
4. BATTERY CHARGE INDICATOR LOCATED ON DRIVER'S SEAT RISER
5. DRIP PAN GUARD FOR ROLL-UP DOOR LOCATED ON ALL BODY COMPARTMENTS
6. ONE FLOOR MOUNTED SLIDE-OUT TRAY IN COMPARTMENT LS1
7. SLIDE-OUT TOOLBOARD WITH PAC TRAC MOUNTING TRACKS IN COMPARTMENT LS1
8. SHORELINE RECEPTACLE LOCATED ON DRIVER'S SEAT RISER
9. ONE FULL WIDTH/DEPTH ADJ SHELF LOCATED (TBD)
10. CIRCUIT BREAKER PANEL & SUB-FEED BREAKER BOX LOCATED IN COMPARTMENT LS3
11. ONE VERTICAL PARTITION IN COMPARTMENT LS1 - TWO IN LS3
12. CTECH 4-DRAWER DRAWER ASSEMBLY ON FLOOR & REARWARD IN LS3
13. ONE HANNAY ELECTRIC REWIND CORD REEL MODEL 1618-17-18 WITH 200' OF 10/4 WIRE, JUNCTION BOX & JUNCTION BOX HOLDER LOCATED FORWARD IN HATCH COMPARTMENT, EACH SIDE
14. PULL STRAP ON SIDE BODY & PUMP HOUSE RULL-UP DOORS
15. LITTLE GIANT SUPER DUTY 1AA-MODEL 17 104002 LOCATED IN LS3
16. DUAL L.E.D. STRIP LIGHTS IN CARGO AREA(S) FOR WALKING SURFACE ILLUMINATION
17. ONE 0.75" DIRECT TANK FILL LOCATED ON LOWER LS PUMP PANEL
18. TWO 15/20A 120V DUPLEX RECEPTACLES LOCATED INSIDE CAB
19. ONE 15/20A 120V DUPLEX RECEPTACLE IN COMPARTMENTS LS3 & RS1

REV	DATE	BY	CH
7	090CT18	GVH	DTS
6	26SEP18	GVH	DTS
5	25SEP18	GVH	DTS
4	25JUL18	GVH	NPA

CHASSIS DATA
MAKE: PIERCE
MODEL: QUANTUM

Pierce MANUFACTURING INC.

TITLE: 1500-D-530P, 500G WATER, 30G FOAM, 161" RESCUE (3) SPEEDLAYS, DELUGE, CABLE & BOOSTER REELS
FOR: OKOLONA FIRE PROTECTION DISTRICT LOUISVILLE, KY
DWG NO.: 32676AD

JOB NO.	32676
SCALE	1:24
DATE	
DRAWN BY	GVH 19JUL18
CHECKED BY	NPA 19JUL18
SHEET SIZE	D
SHEET NO.	1 OF 1

View File Created 10-OCT-2018 11:08:55