
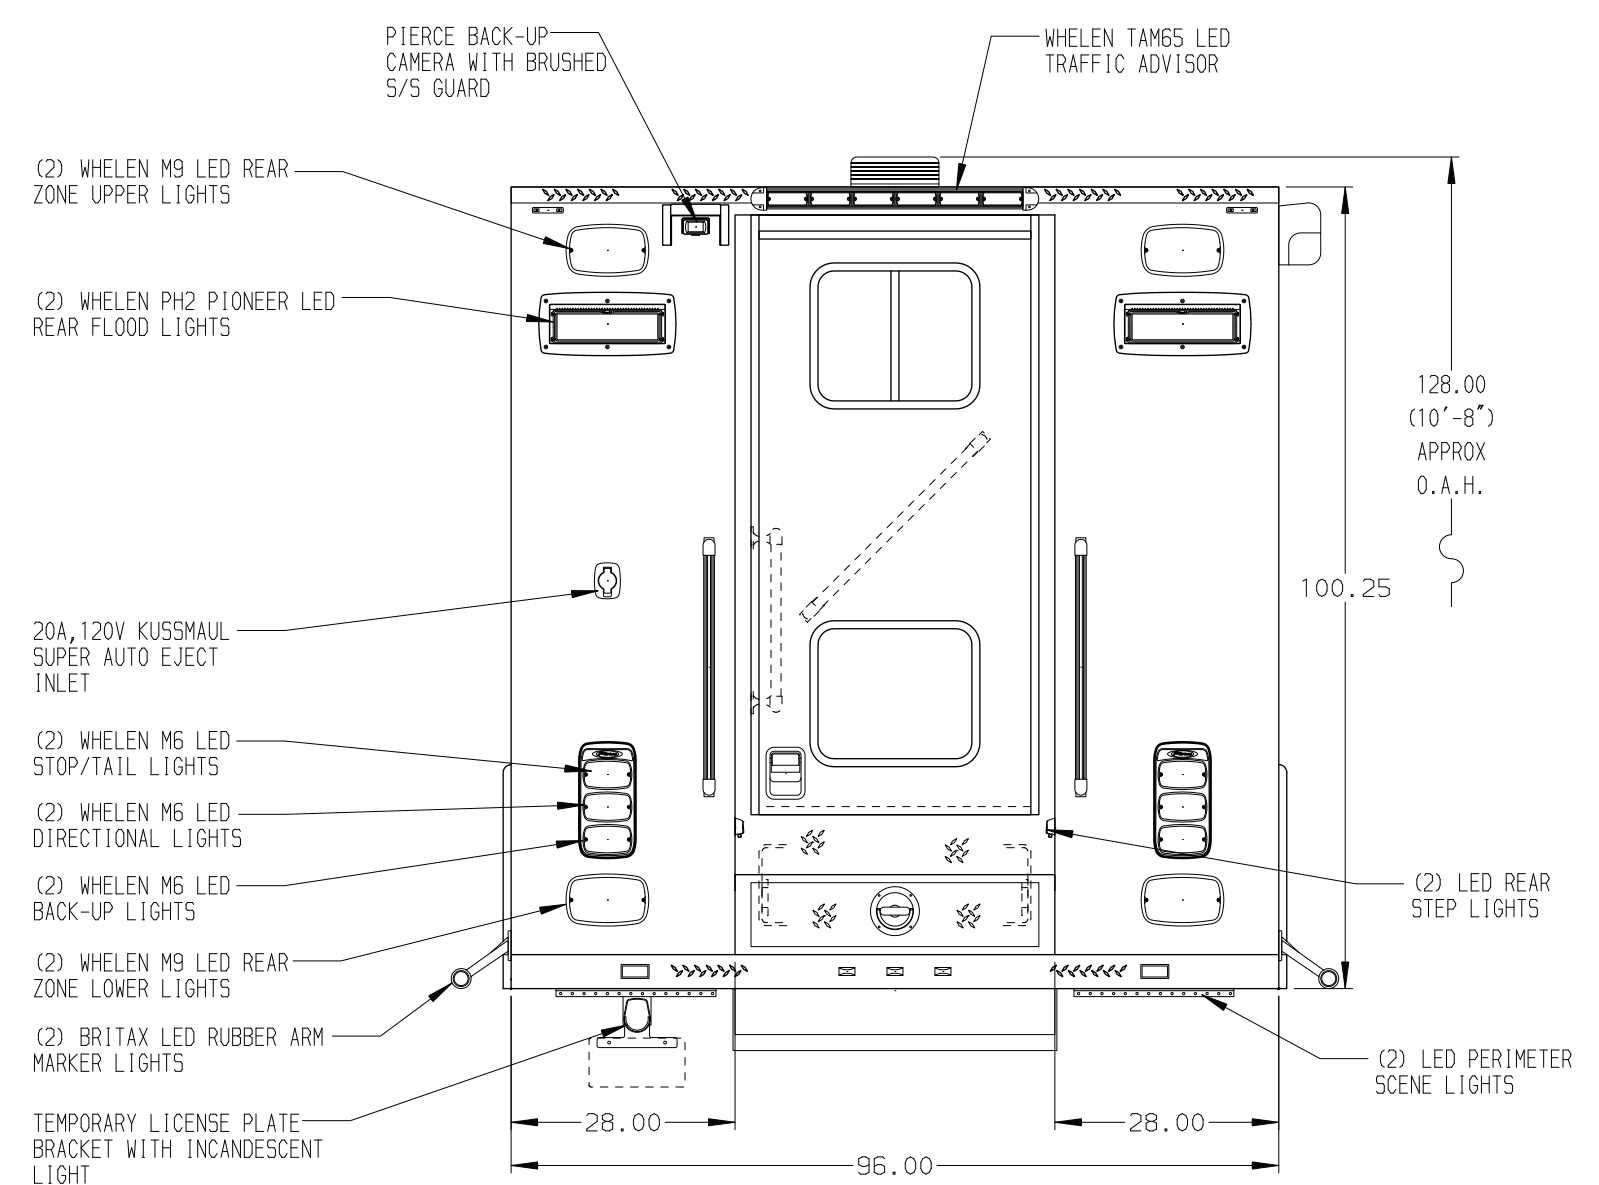
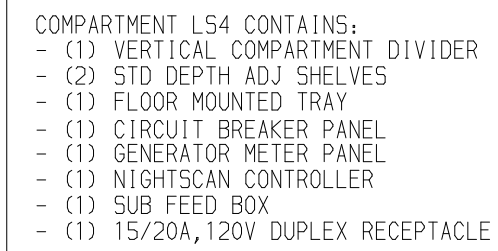


COMPARTMENT RS4 CONTAINS:

- (1) CAB LIFT CONTROLLER
- (1) STD DEPTH ADJ SLIDE OUT TRAY
- (1) FLOOR MOUNTED TRAY
- (1) 15/20A, 120V DUPLEX RECEPTACLE
- (1) 30A, 240V T.L. RECEPTACLE
- (1) SWITCH FOR 240V RECEPTACLE

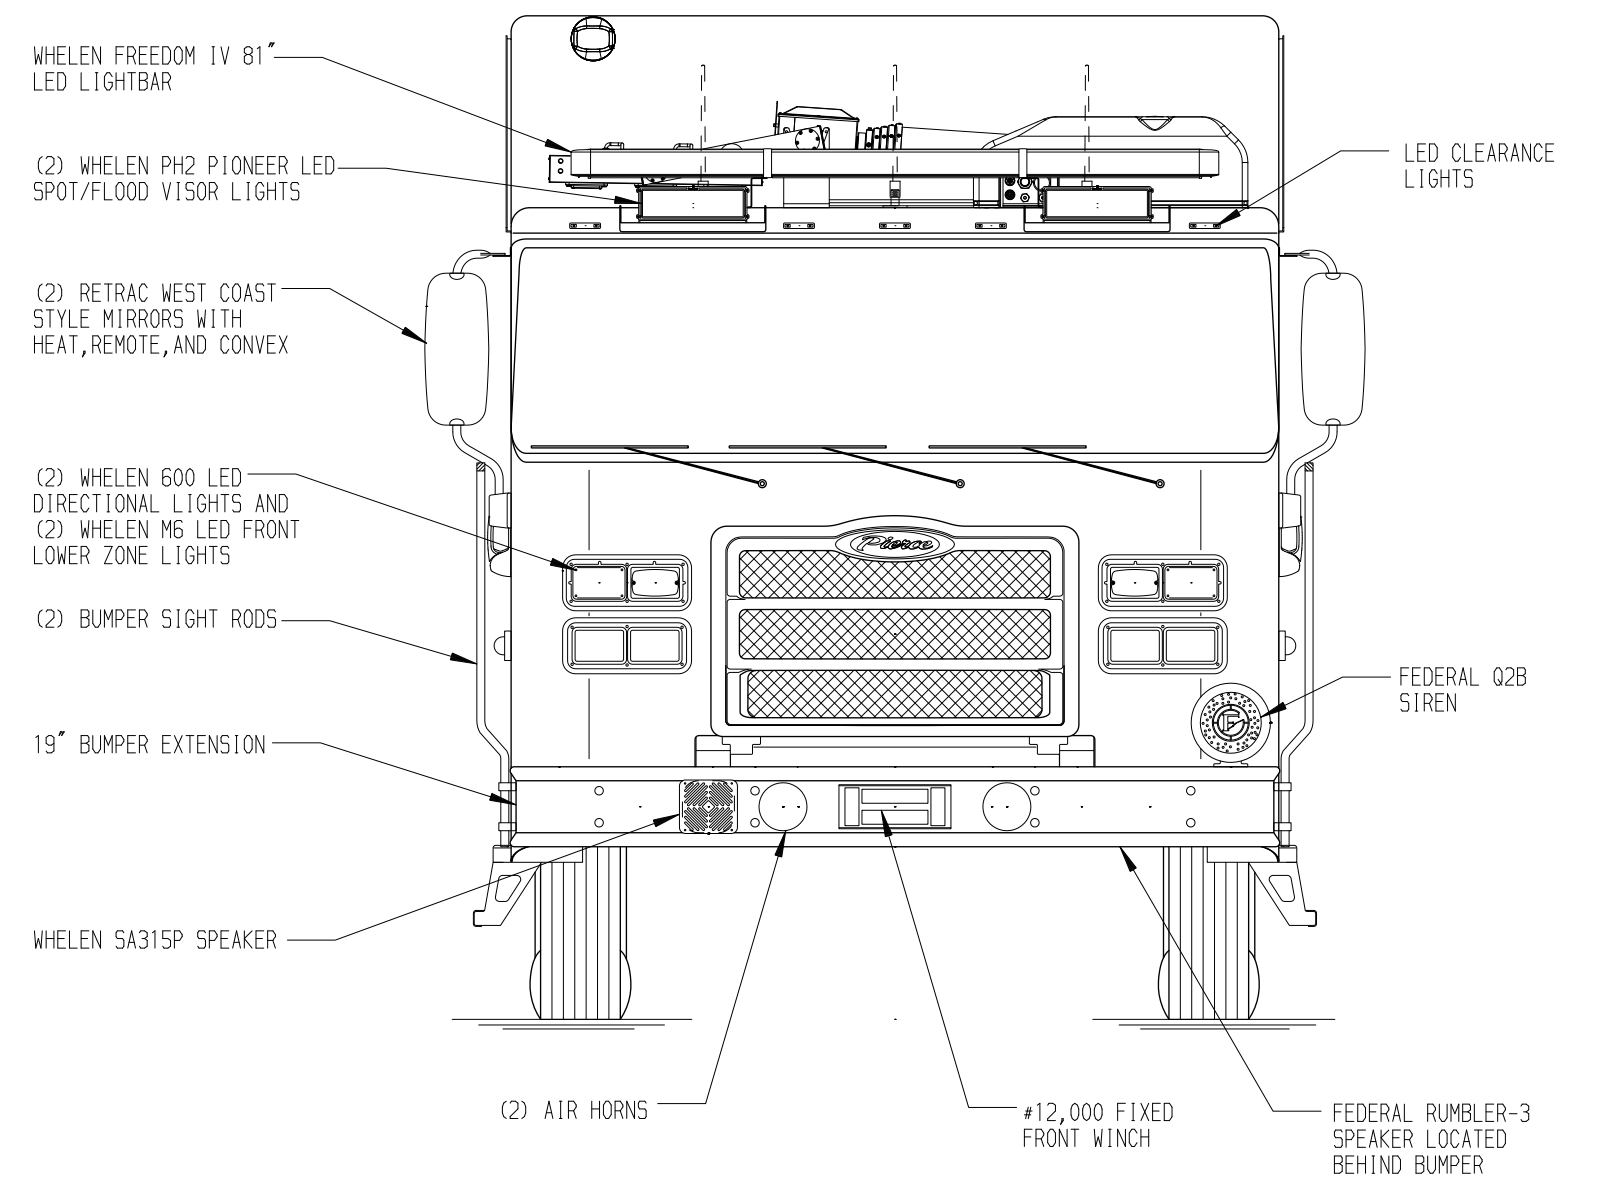

 MANUFACTURING INC.			JOB NO.	33105
			SCALE 1:24	DATE
S	TITLE	HEAVY DUTY RESCUE WALKIN	DRAWN BY DHE	150CT18
E	FOR	U-CREST FIRE DISTRICT NO. 4 U-CREST, NY	CHECKED BY AZU	150CT18
4	DWG NO.	33105AD-SH1		SHEET SIZE D
				SHEET NO. 1 OF 1

NOTES:

- 1. OWAN 25kw SINGLE PHASE PTO DRIVEN GENERATOR WITH SPLASH GUARD LOCATED BETWEEN THE FRAME RAIL AND AIR INLET WITH CONNECTION TO COVERED AREA IN THE DRIVER'S SIDE LOWER STEP WELL OF CAB
- 2. BRUSHED 5/5'S SCRUFFLATE ON REAR OF ENGINE TUNNEL
- 3. POLISHED 5/5'S SCRUFFLATES ON CAB AND CREW CAB DOOR JAMBS
- 4. FLOOR IN CAB AND CREW CAB TO BE PAIDED RUBBER
- 5. KUSSMAUL PUMP BODY 1200V CHARGER LOCATED BEHIND THE DRIVER'S SEAT
- 6. 5/5'S GUARDS ON ALL BODY ROLL-UP DOORS
- 7. AMOR LED LIGHTS IN ALL EXTERIOR BODY COMPARTMENTS
- 8. COMPARTMENT VENTILATION SYSTEM
- 9. 15/20A, 120V DUPLEX RECEPTACLE LOCATED BEHIND THE DRIVER AND OFFICER SEATS ON ENGINE TUNNEL

(MAXIMUM O.A.L. 32'-0") (MAXIMUM O.A.H. 10'-8")

CLEAR DOOR WIDTH KEY					CHASSIS DATA
AMDR ROLL UP DOORS:	-2 1/4"				MAKE
GORTITE ROLL UP DOORS:	-2 1/2"		18FEB19	DHE	AZU
PIERCE DOUBLE LAP DOORS:	-4 1/4"		19DEC18	ALZ	AZU
PIERCE LIFT-UP LAP DOORS:	-1 1/2"		30OCT18	ALZ	AZU
(EX: 60°F - 2 1/4" = 57 3/4" CLEAR) (F-F) = FRAME TO FRAME					
		REV	DATE	BY	CH
					EN7024