

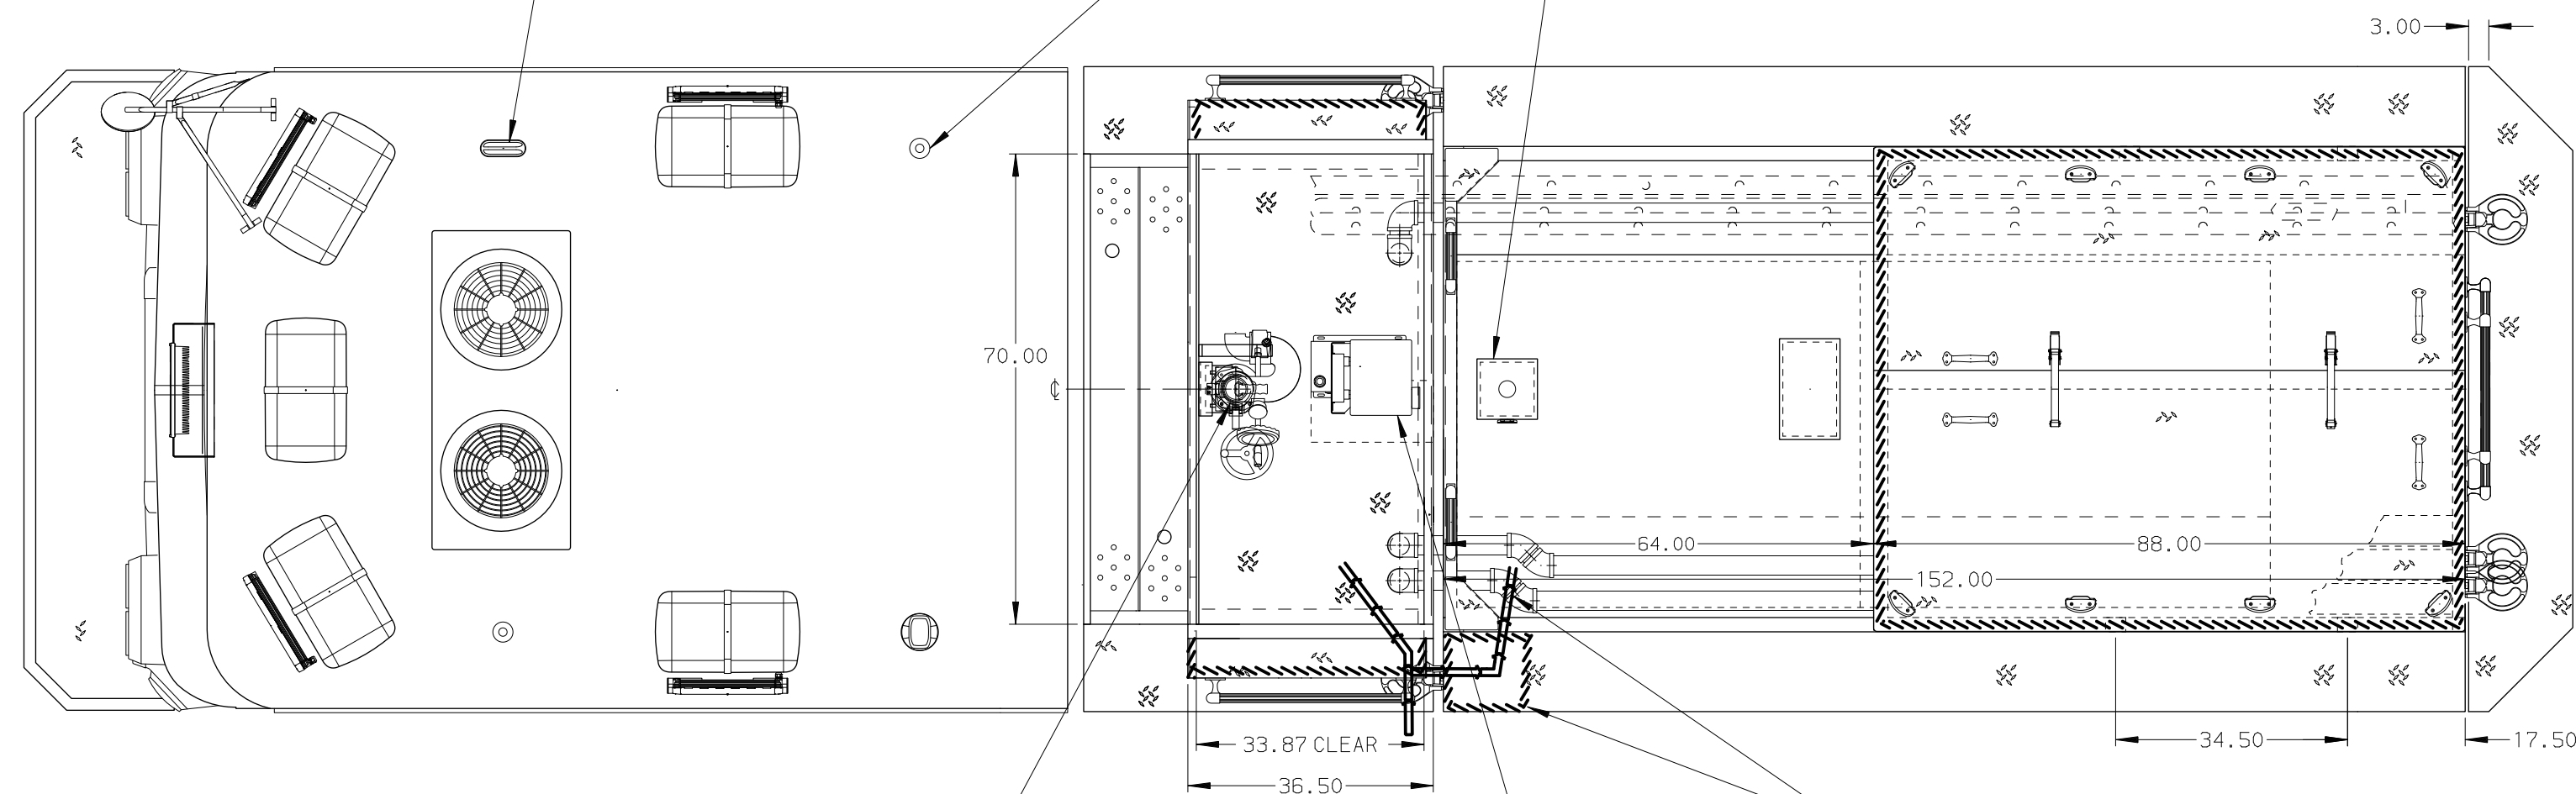
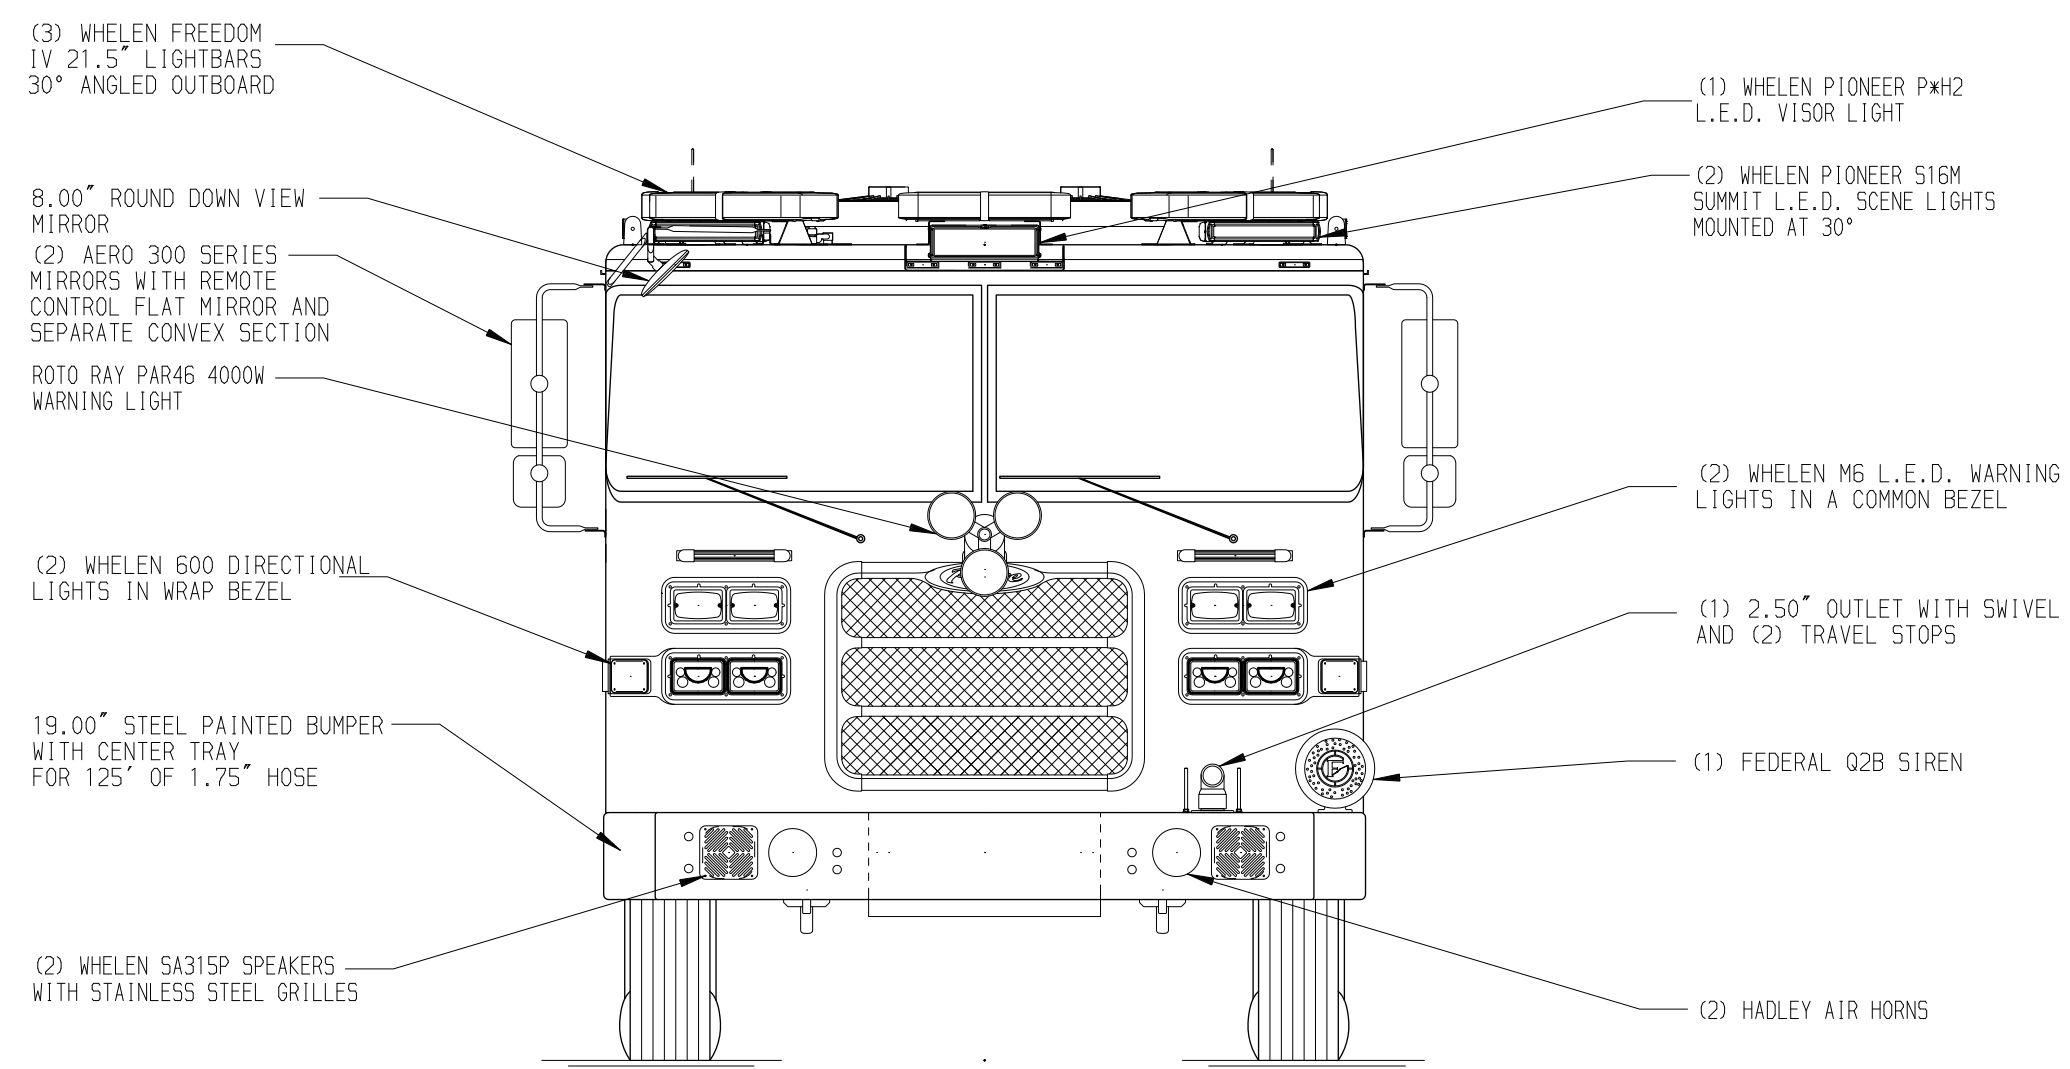
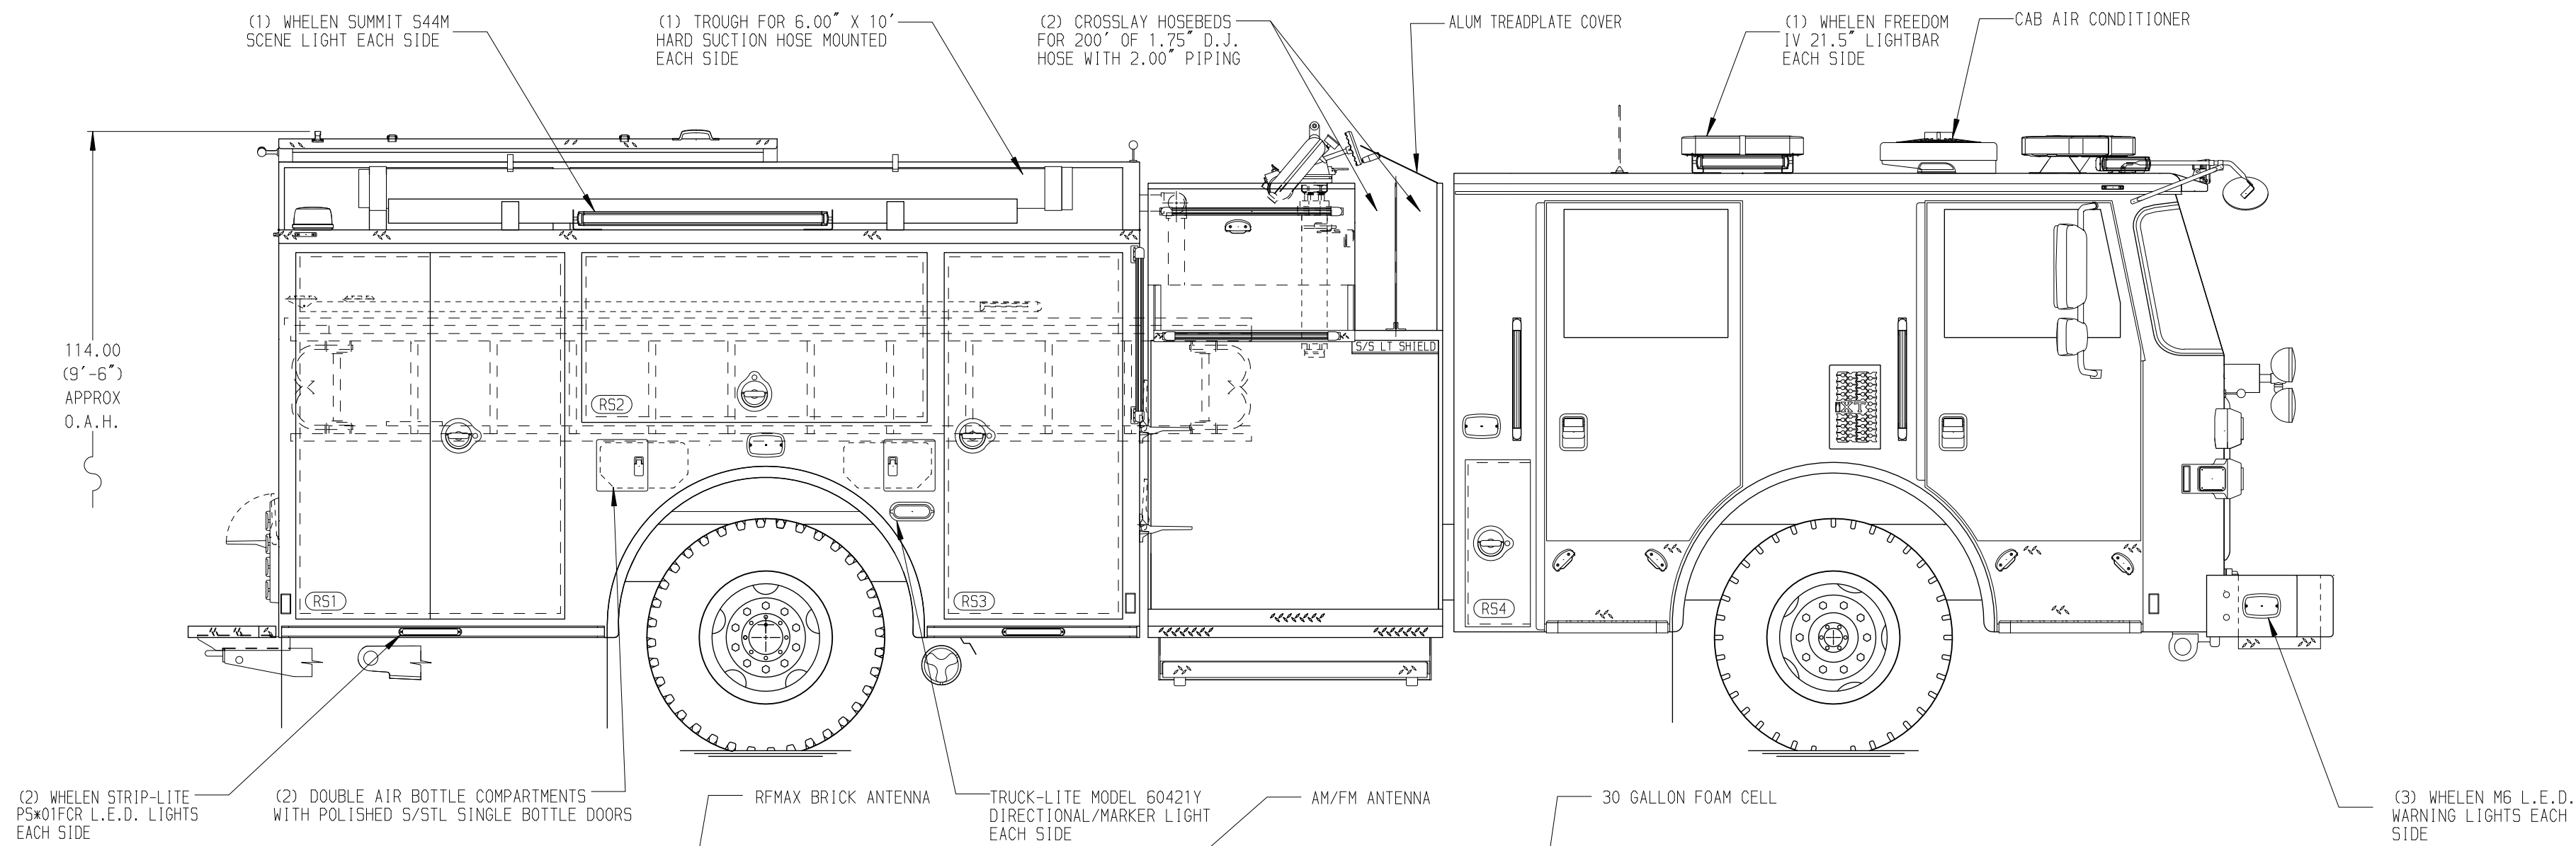


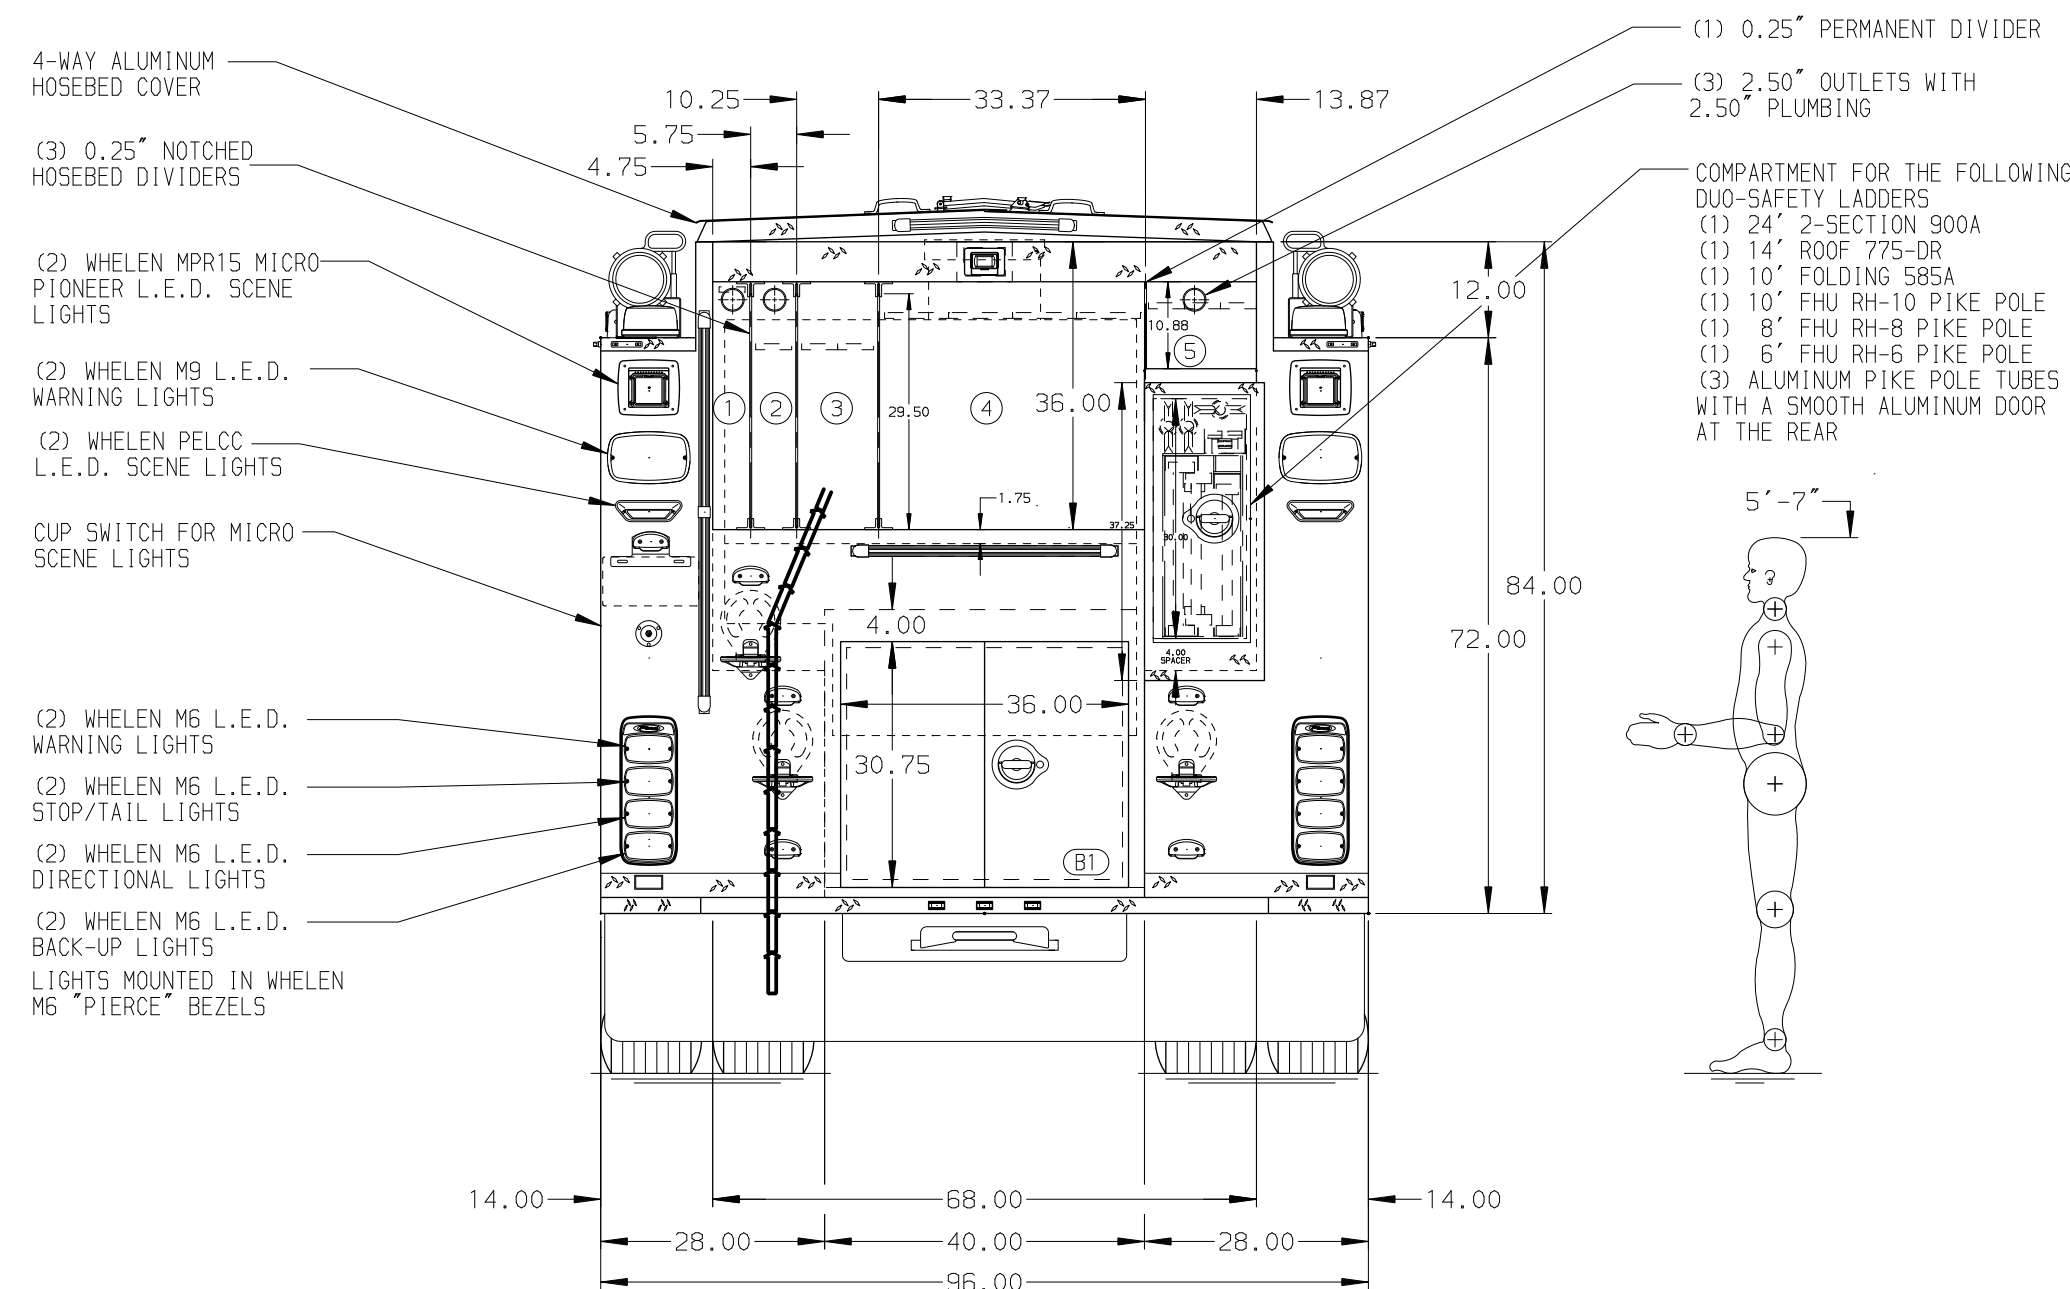

- HOSEBED CAPACITIES
- ① - 300' OF 1.75" D.J. POLY HOSE (SINGLE STACK)
 - ② - 200' OF 2.50" D.J. POLY HOSE (SINGLE STACK)
 - ③ - 400' OF 2.50" D.J. POLY HOSE (DOUBLE STACK)
 - ④ - 1000' OF 5.00" D.J. POLY HOSE
 - ⑤ - 200' OF 2.50" D.J. POLY HOSE

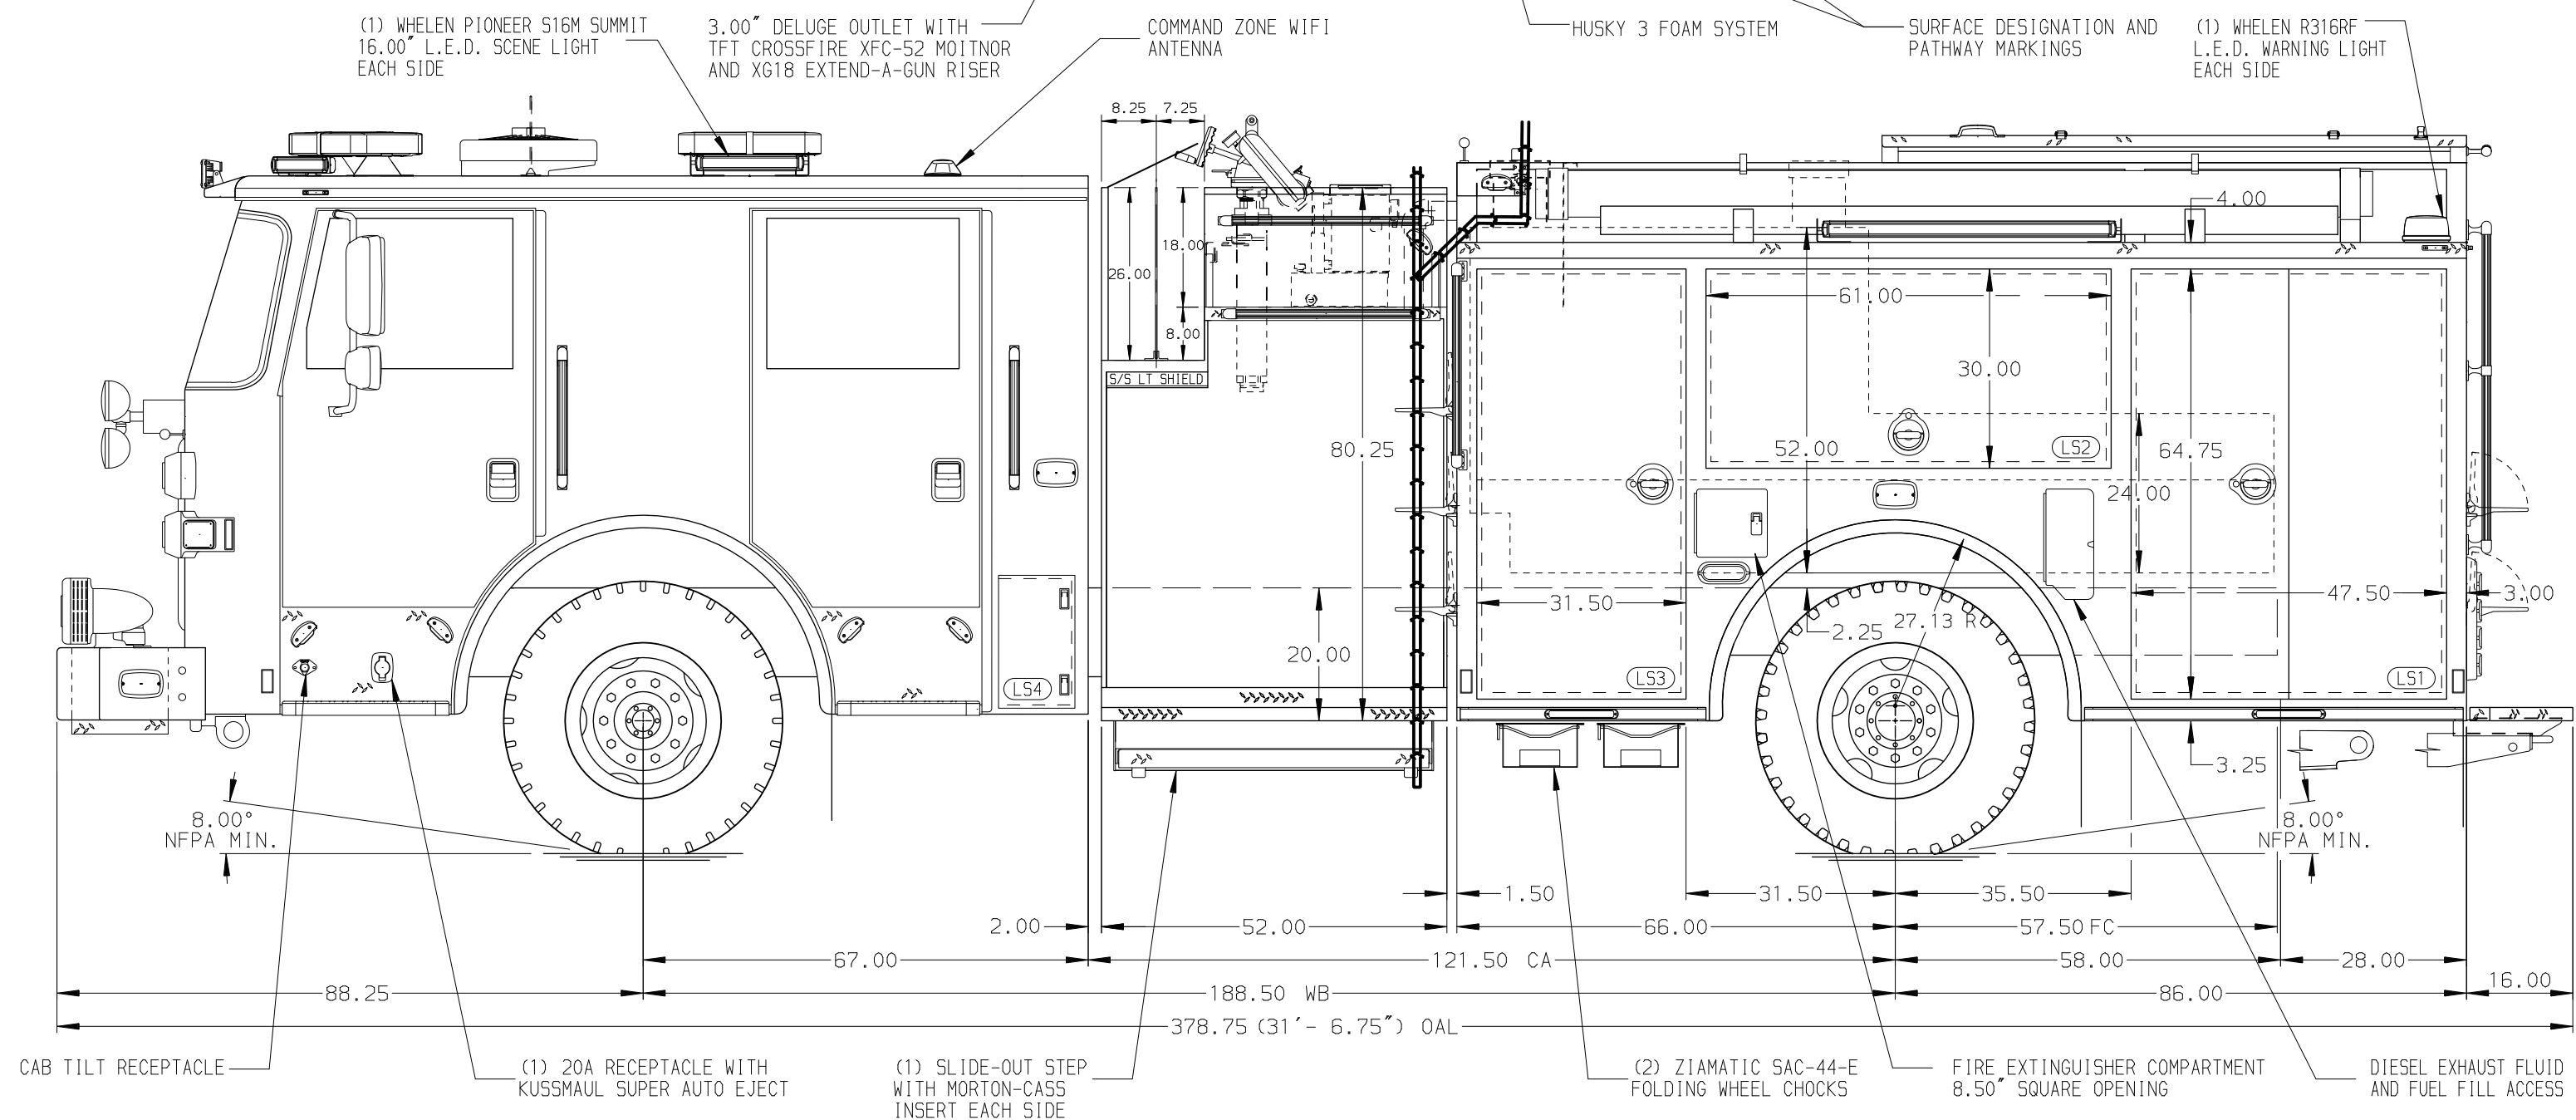

ALUMINUM BODY

NOTE

DIMENSIONS SHOWN ARE APPROXIMATE AND ARE SUBJECT TO MINOR DEVIATIONS AS MAY OCCUR OR BE NECESSARY IN CONSTRUCTION. MINOR DETAILS NOT SHOWN.

1. KUSSMAUL PUMP PLUS 1200 BATTERY CHARGER LOCATED IN COMPARTMENT PER ORDER
2. BATTERY CHARGE INDICATOR LOCATED ON DRIVER SEAT WITH BRACKET
3. AIR OUTLET WITH SHUT-OFF VALVE ON DS PUMP PANEL

REV	DATE	BY	CH	ARROW XT
19DEC24	KLE	JGO		
07NOV24	JJB	JGO		
01AUG24	AKR	WKL		

TITLE	1750 GPM, 780G TANK, 750G WATER, 30G FOAM 152" PUMPER, MUX
FOR	NORTH CHARLESTON FIRE DEPARTMENT NORTH CHARLESTON, SC
DWG NO.	39081 AD

CHASSIS DATA	MAKE	PIERCE	MODEL	ARROW XT
JOB NO.	39081	SCALE	1:24	DATE
DRAWN BY	AKR	11JUL24	CHECKED BY	EGO
22JUL24	SHEET SIZE	D	SHEET NO.	1 OF 1