



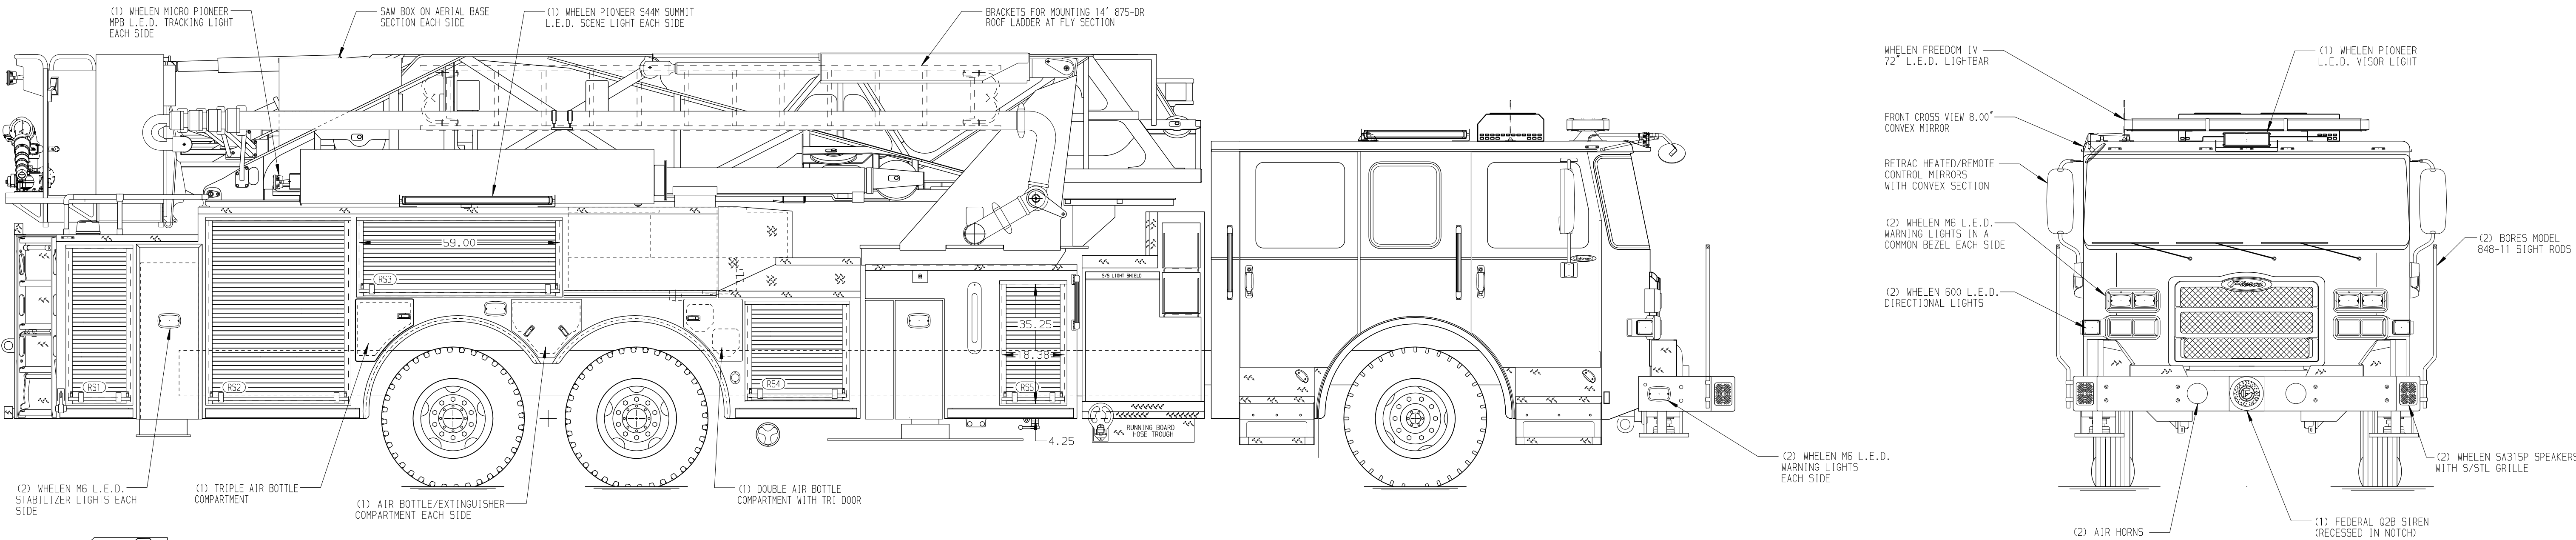

BODY 100' Ascendant Aerial Tower Alum Body COMPT, LEFT SIDE Full Height & Full Depth RollUp Doors COMPT, RIGHT SIDE Full Height RollUp Doors	TOTAL TANK CAPACITY 300 Gallon Poly Tank WATER CAPACITY 300 Gallons of Water FOAM CELL CAPACITY Foam Cell Not Required FOAM SYSTEM Foam System Not Required
--	--

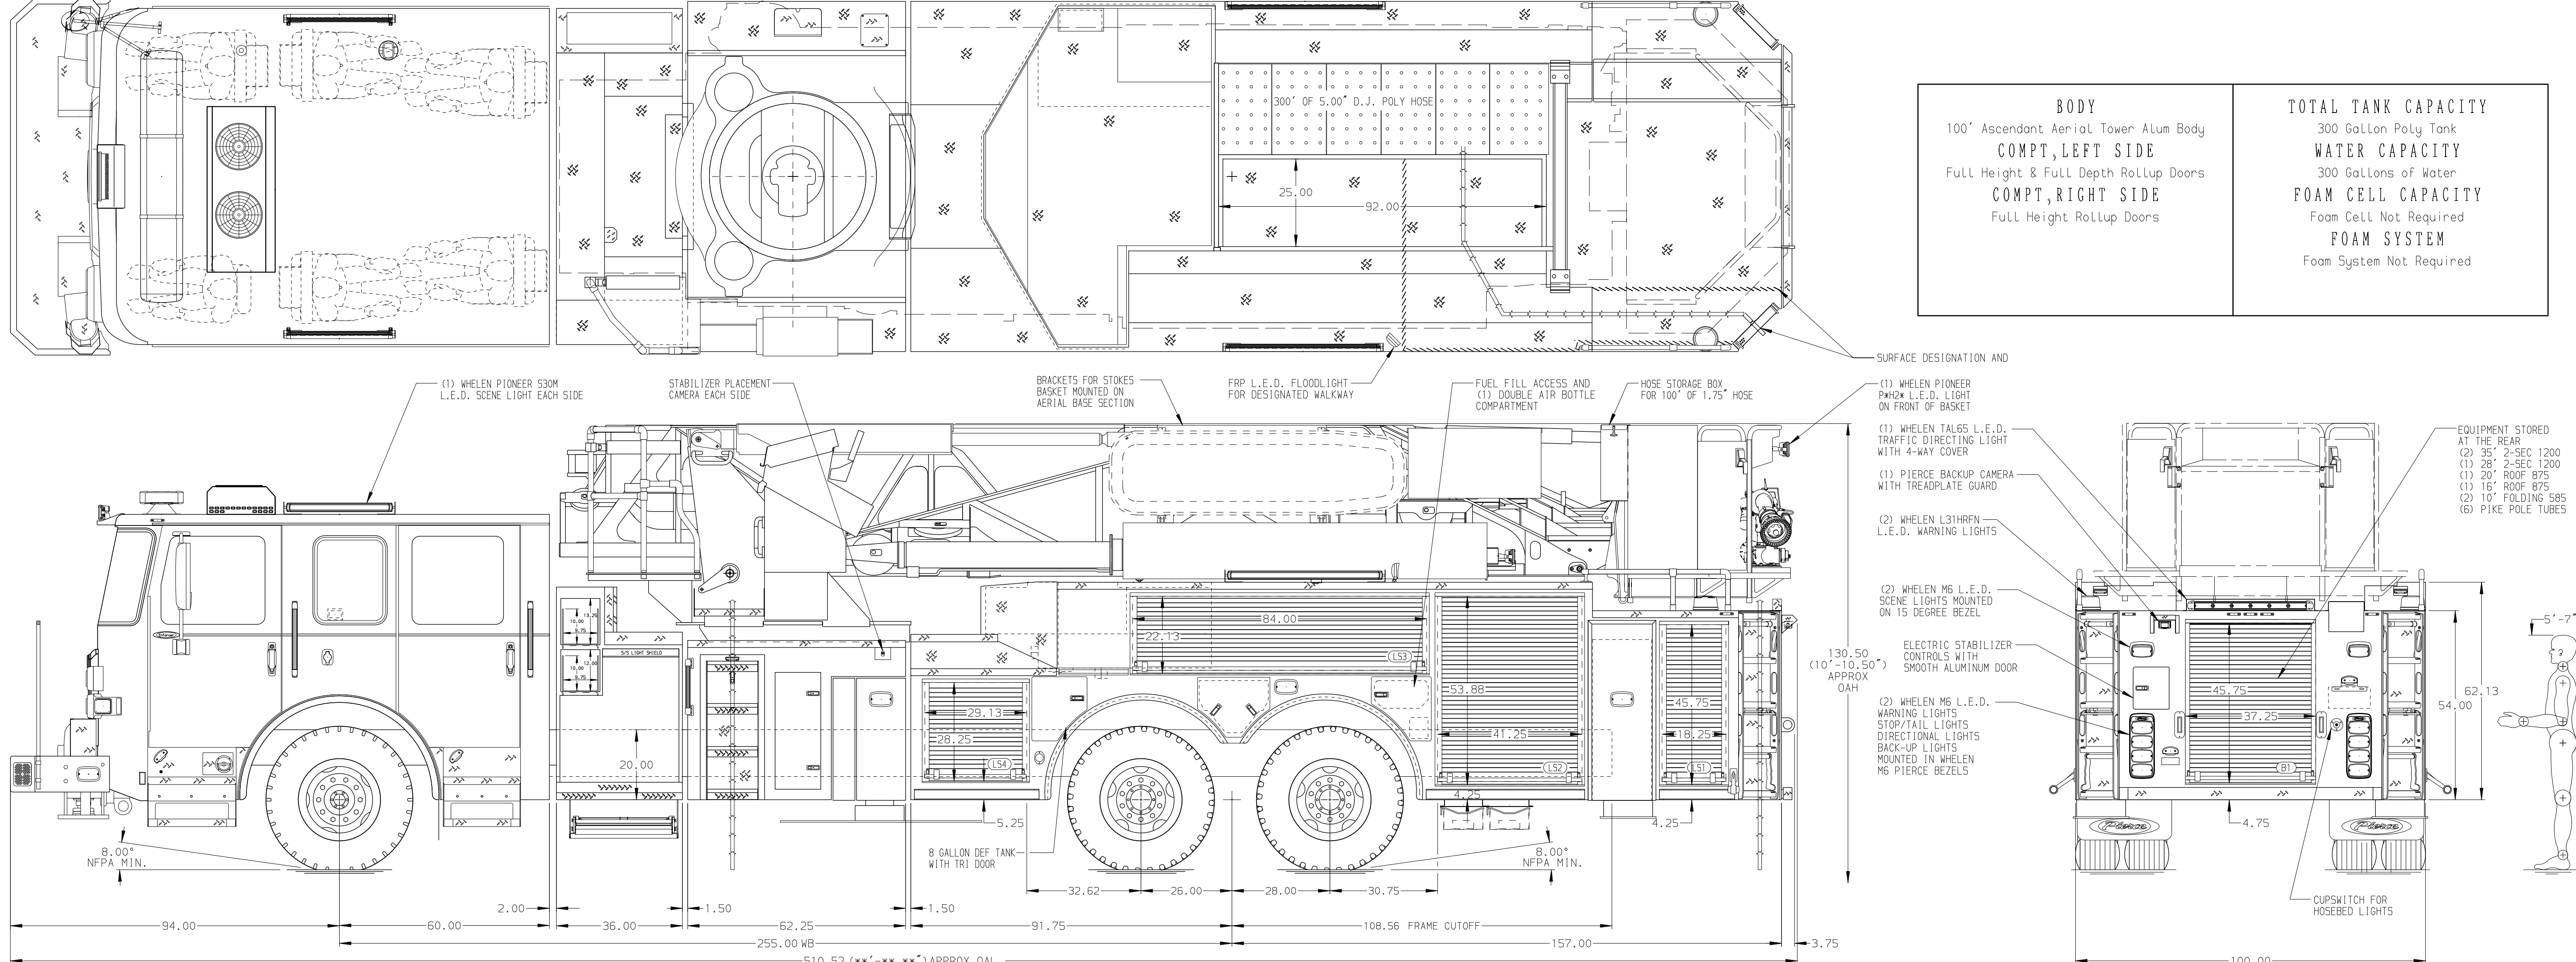

CHASSIS Enforcer Chassis ENGINE 605 HP Cummins X15 Engine		CAB 6000 Enforcer Cab BUMPER 24" Painted Aluminum		AXLE, FRONT, CUSTOM 23,000 Lb Dana D-2200F Axle AXLE, REAR 54,000 Lb Meritor Axle		TRANSMISSION Allison 6th Gen, 4500 EVS P		PUMPHOUSE 36" Control Zone Side Mount PUMP 2000 GPM Waterous S100		CROSSLAYS, 1.50" (2) 1.50", With Trays, 200' CROSSLAYS, 2.50" 2.50" CrossLay Not Required		SPEEDLAYS SpeedLays Not Required GENERATOR Generator Not Required		 MANUFACTURING INC.		JOB NO.	40961
												SCALE 1:24	DATE				
NOTE DIMENSIONS SHOWN ARE APPROXIMATE AND ARE SUBJECT TO MINOR DEVIATIONS AS MAY OCCUR OR BE NECESSARY IN CONSTRUCTION. MINOR DETAILS NOT SHOWN.		1. SHORELINE RECEPTACLE WITH KUSSMAUL SUPER AUTO-EJECT LOCATED ON DRIVER SIDE OF THE CAB 2. DC POWER TO AERIAL TIP 3. BATTERY CHARGER LOCATED BEHIND DRIVER SEAT 4. BATTERY CHARGE INDICATOR DISPLAYED THROUGH WINDOW BEHIND DRIVER SEAT 5. SEVEN ADJUSTABLE SHELVES LOCATED IN COMPARTMENTS PER ORDER 6. ONE AIR OUTLET WITH SHUTOFF VALVE LOCATED PER ORDER 7. AIR INLET WITH DISCONNECT COUPLING LOCATED FORWARD IN THE DRIVER SIDE STEPMELL 8. ONE TILT/SLIDE-OUT TRAY LOCATED IN COMPARTMENT PER ORDER 9. THREE FLOOR MOUNTED SLIDE-OUT TRAYS LOCATED IN COMPARTMENTS PER ORDER 10. TWO TOOLBOARDS ADDED TO SLIDE-OUT TRAYS LOCATED PER ORDER 11. TWO H1VIZ FT-MB-12-TR L.E.D. LIGHTS UNDER BASKET CORNER STEPS 12. TWO VERTICAL PARTITIONS LOCATED IN COMPARTMENTS PER ORDER 13. BACKLIT LASER-ETCHED LETTERING BELOW CAB GRILLE 14. CAB LIFT CONTROLS LOCATED IN DRIVER SIDE STEPMELL 15. 3-in-1 LYFECOMBO BRACKETS AT AERIAL BASKET 16. TWO RECEPTACLE STRIPS LOCATED PER ORDER 17. TECNIO 5-SECTION RUNG LIGHTING AT AERIAL DEVICE										CHASSIS DATA	TITLE	100' ASCENDANT AERIAL TOWER AND BODY ASSEMBLY 300 GALLON WATER TANK		DRAWN BY ANZ	11SEP24
												MAKE	FOR	TROY FIRE DEPARTMENT		CHECKED BY JLO	16SEP24
												PIERCE					
												MODEL					
								REV	DATE	BY	CH	ENFORCER	DWG NO.	40961AD		SHEET SIZE D	SHEET NO. 1 OF 1