

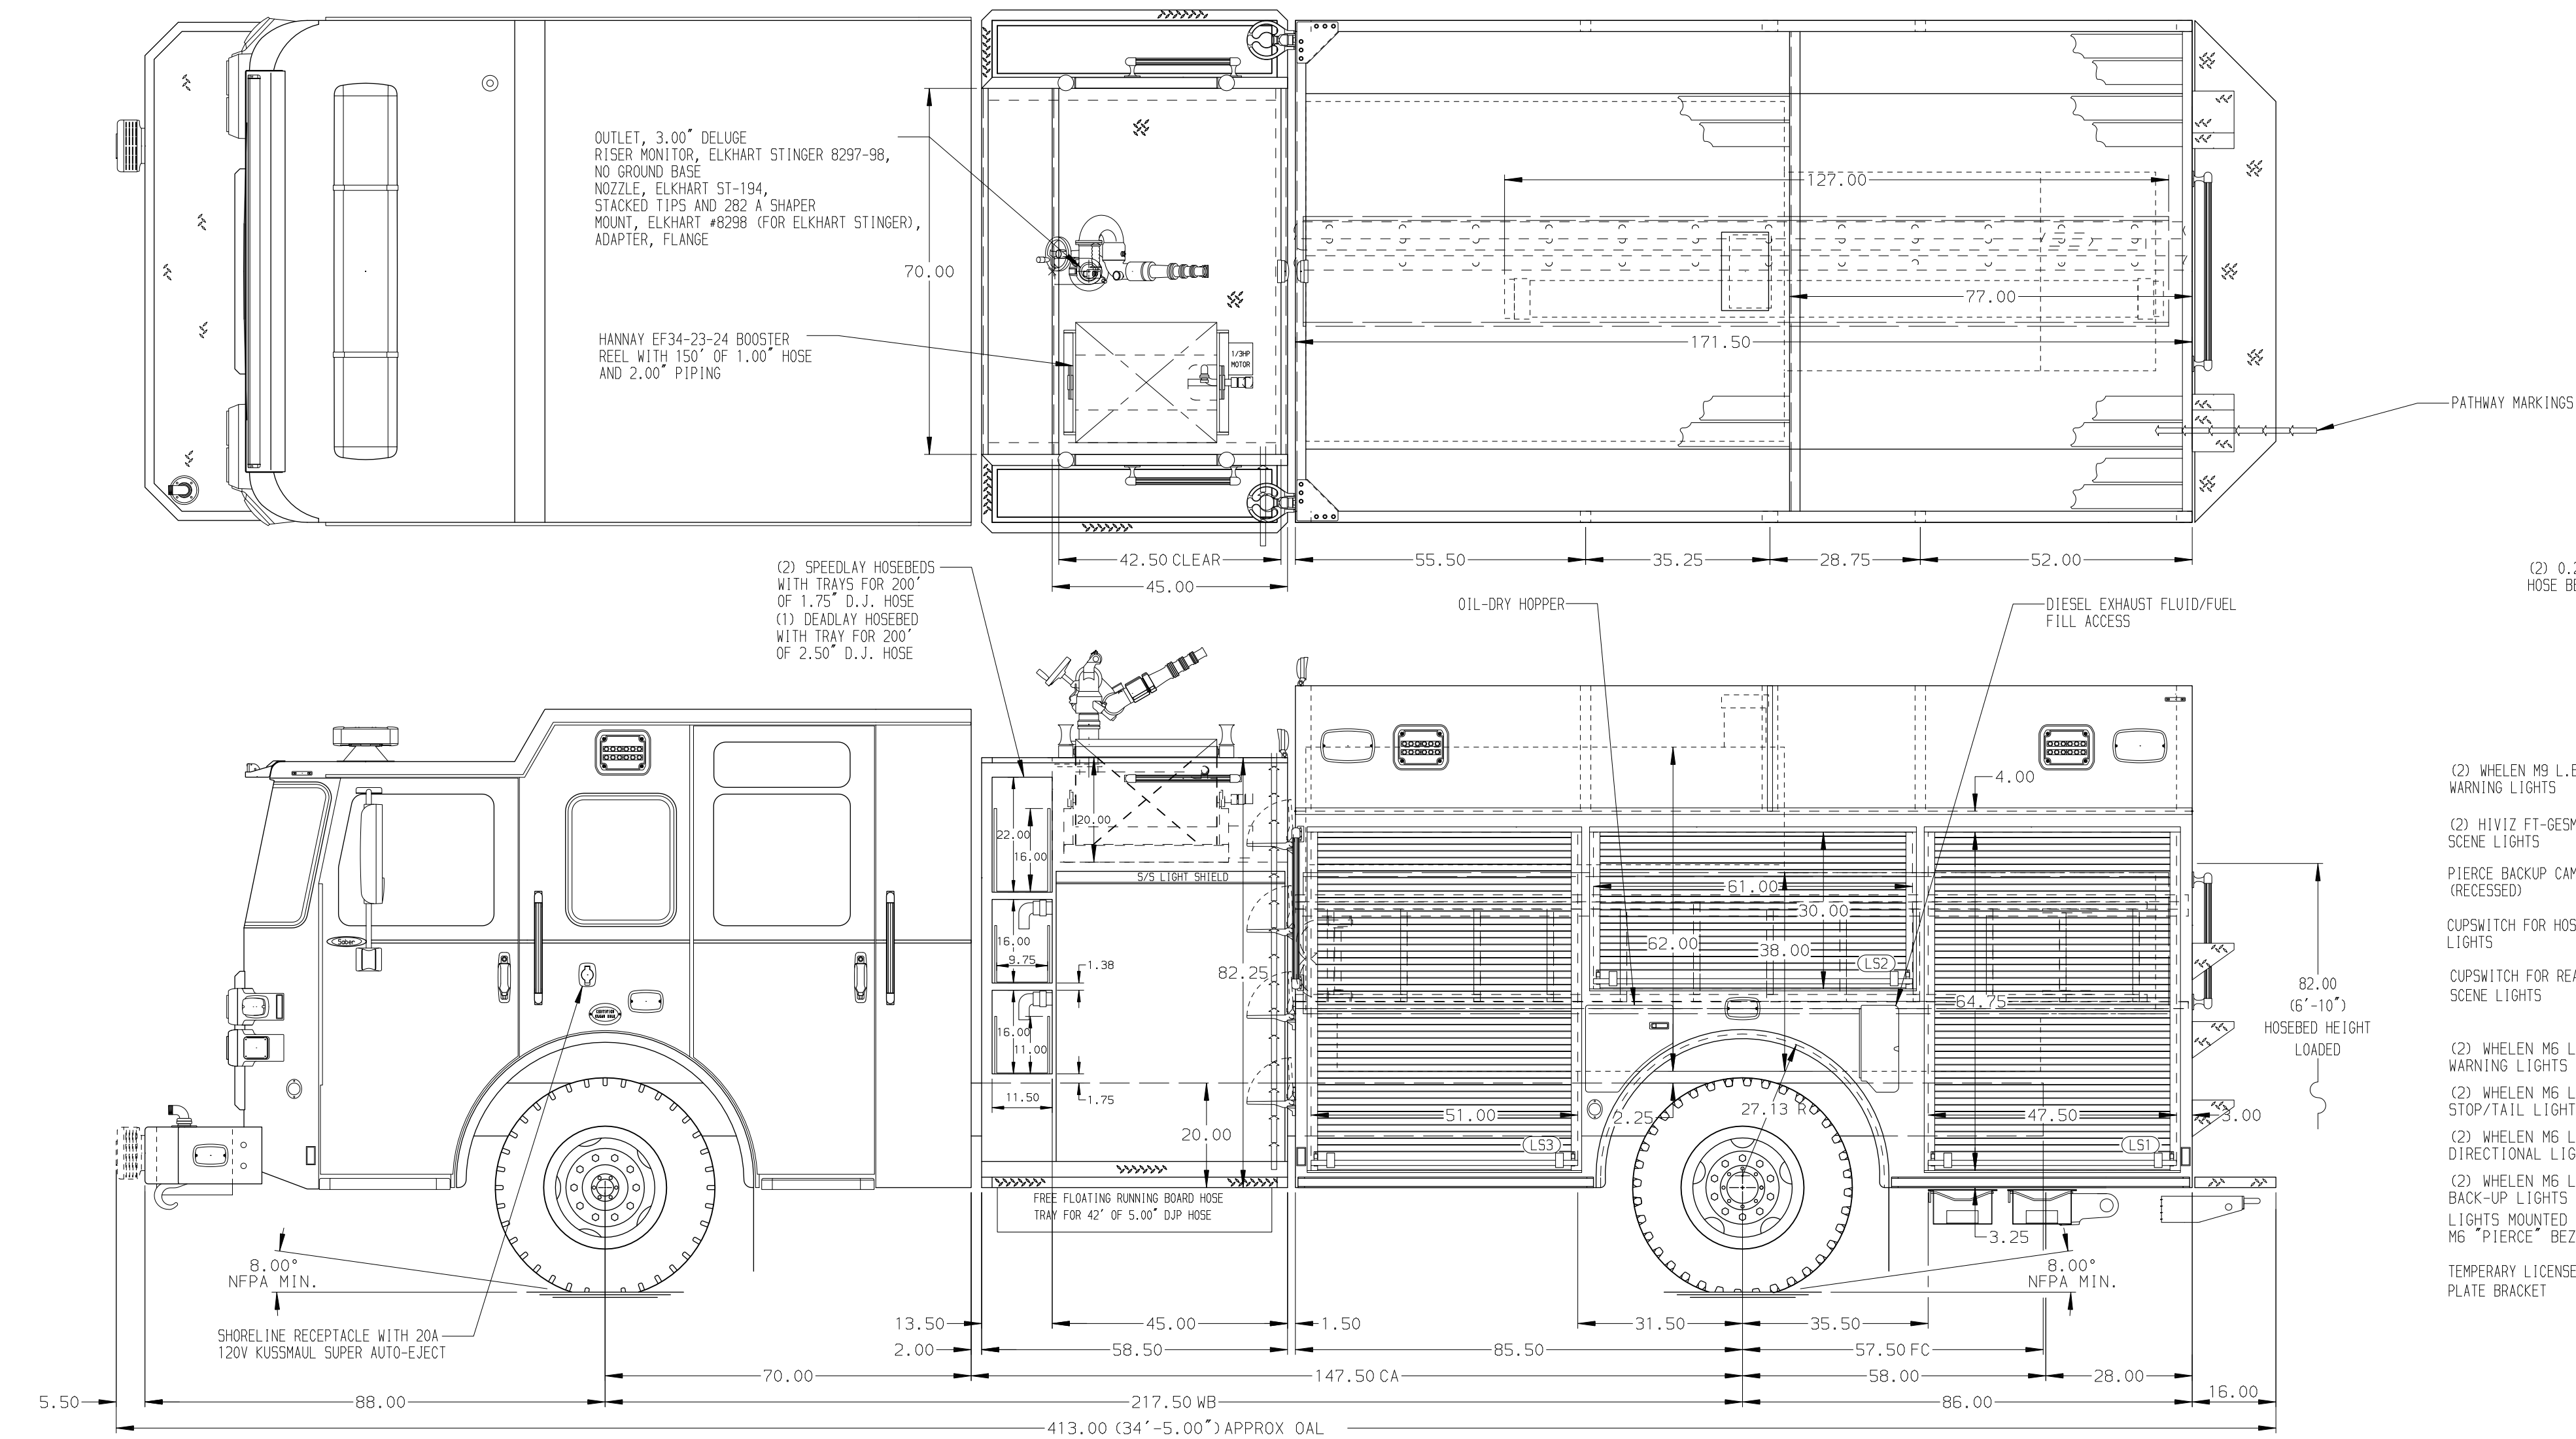
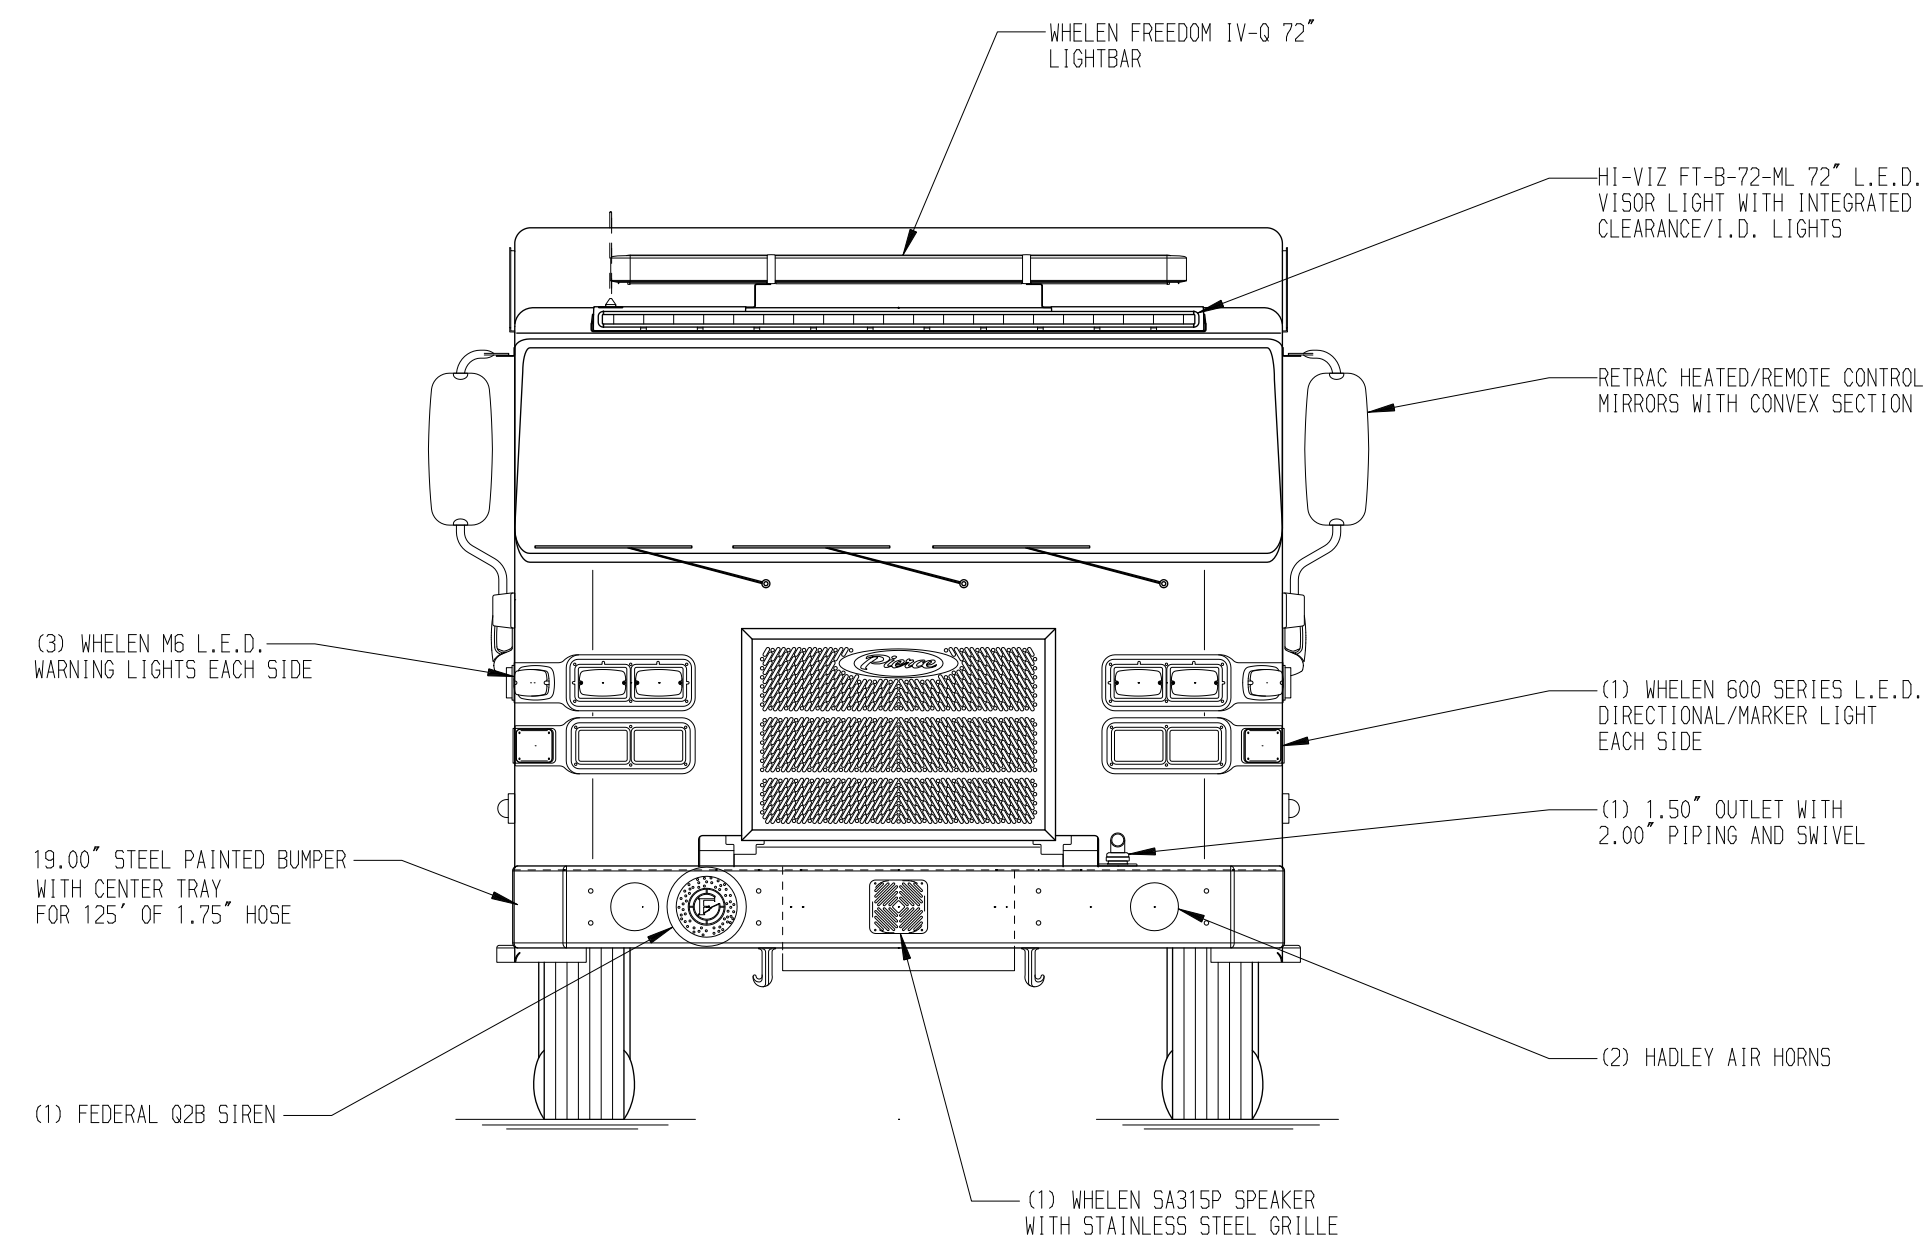


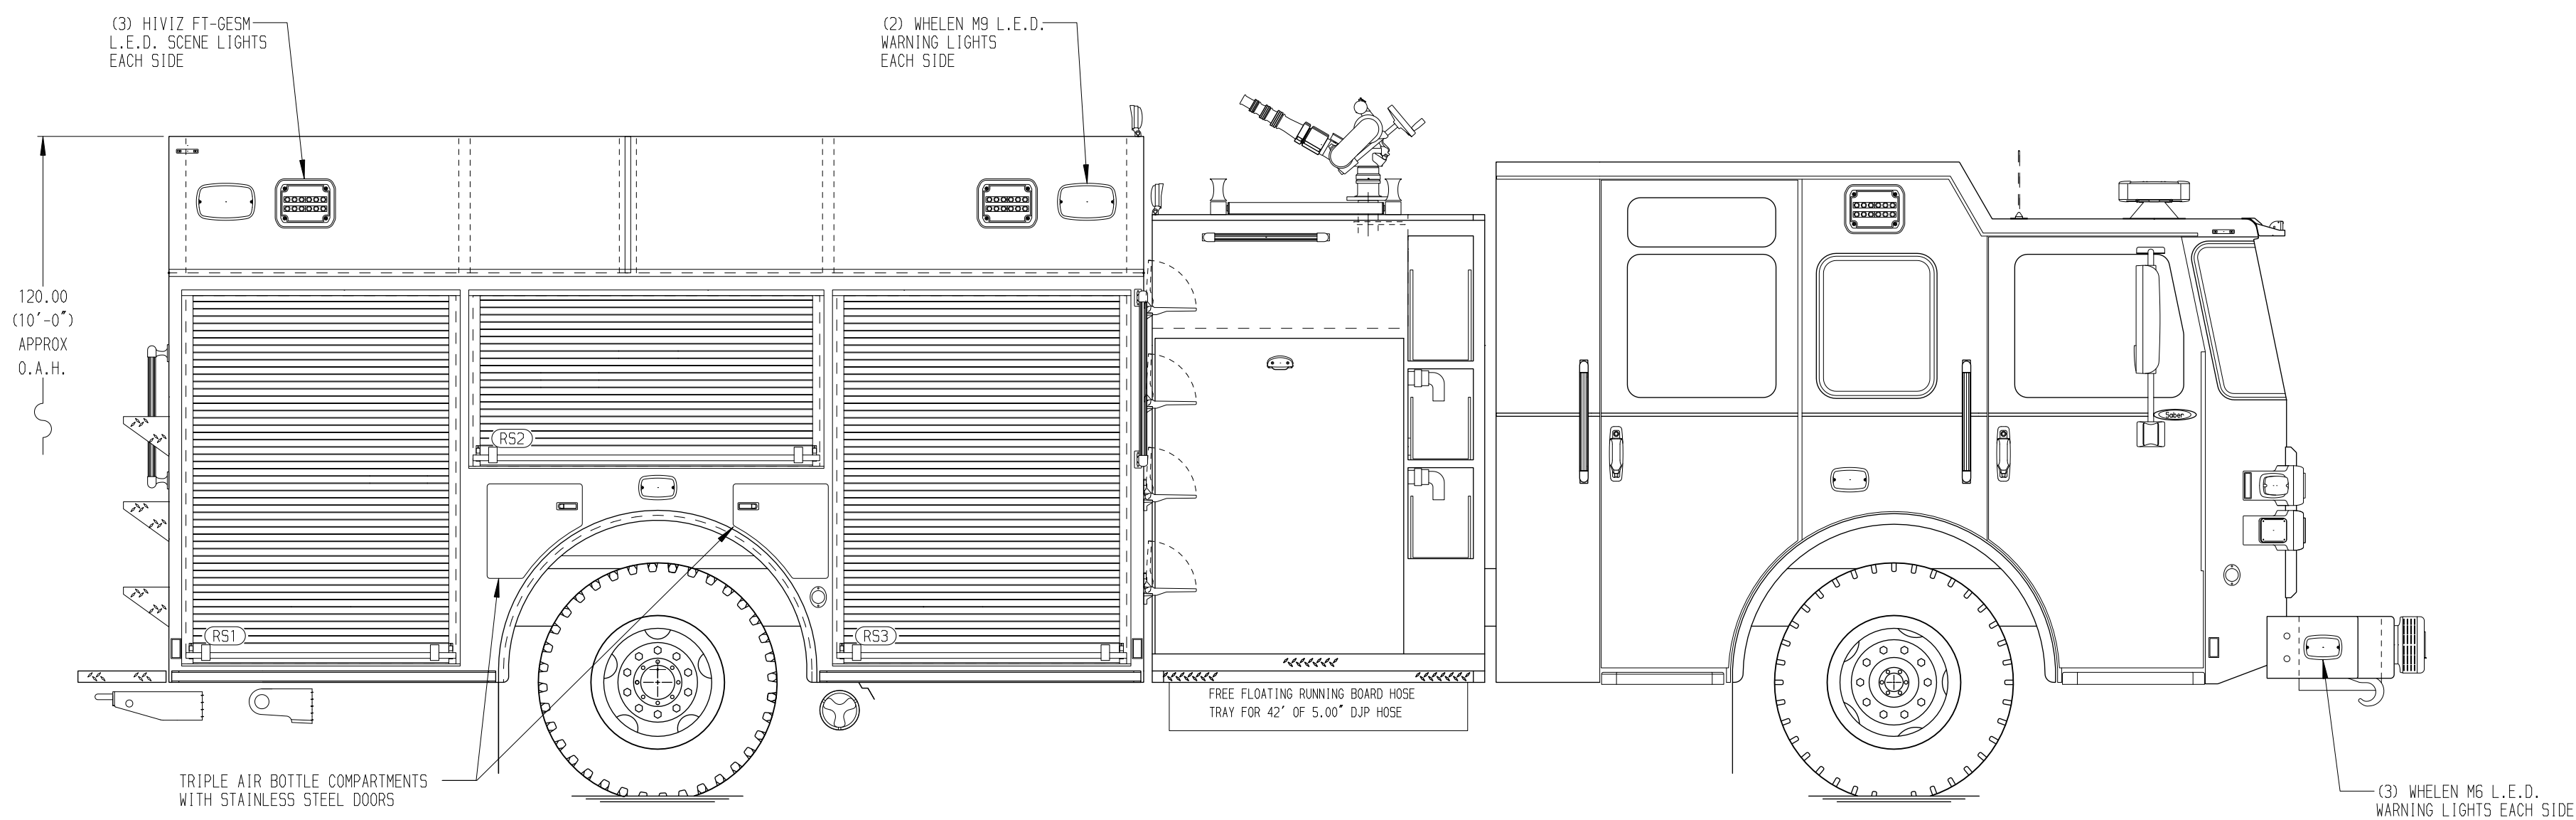

HOSEBED CAPACITIES

- 200' OF 2.50" D.J. POLY HOSE
- 200' OF 2.50" D.J. POLY HOSE
- 1000' OF 4.00" D.J. POLY HOSE
- 400' OF 1.75" D.J. POLY HOSE
- 200' OF 2.50" D.J. POLY HOSE
- 200' OF 2.50" D.J. POLY HOSE

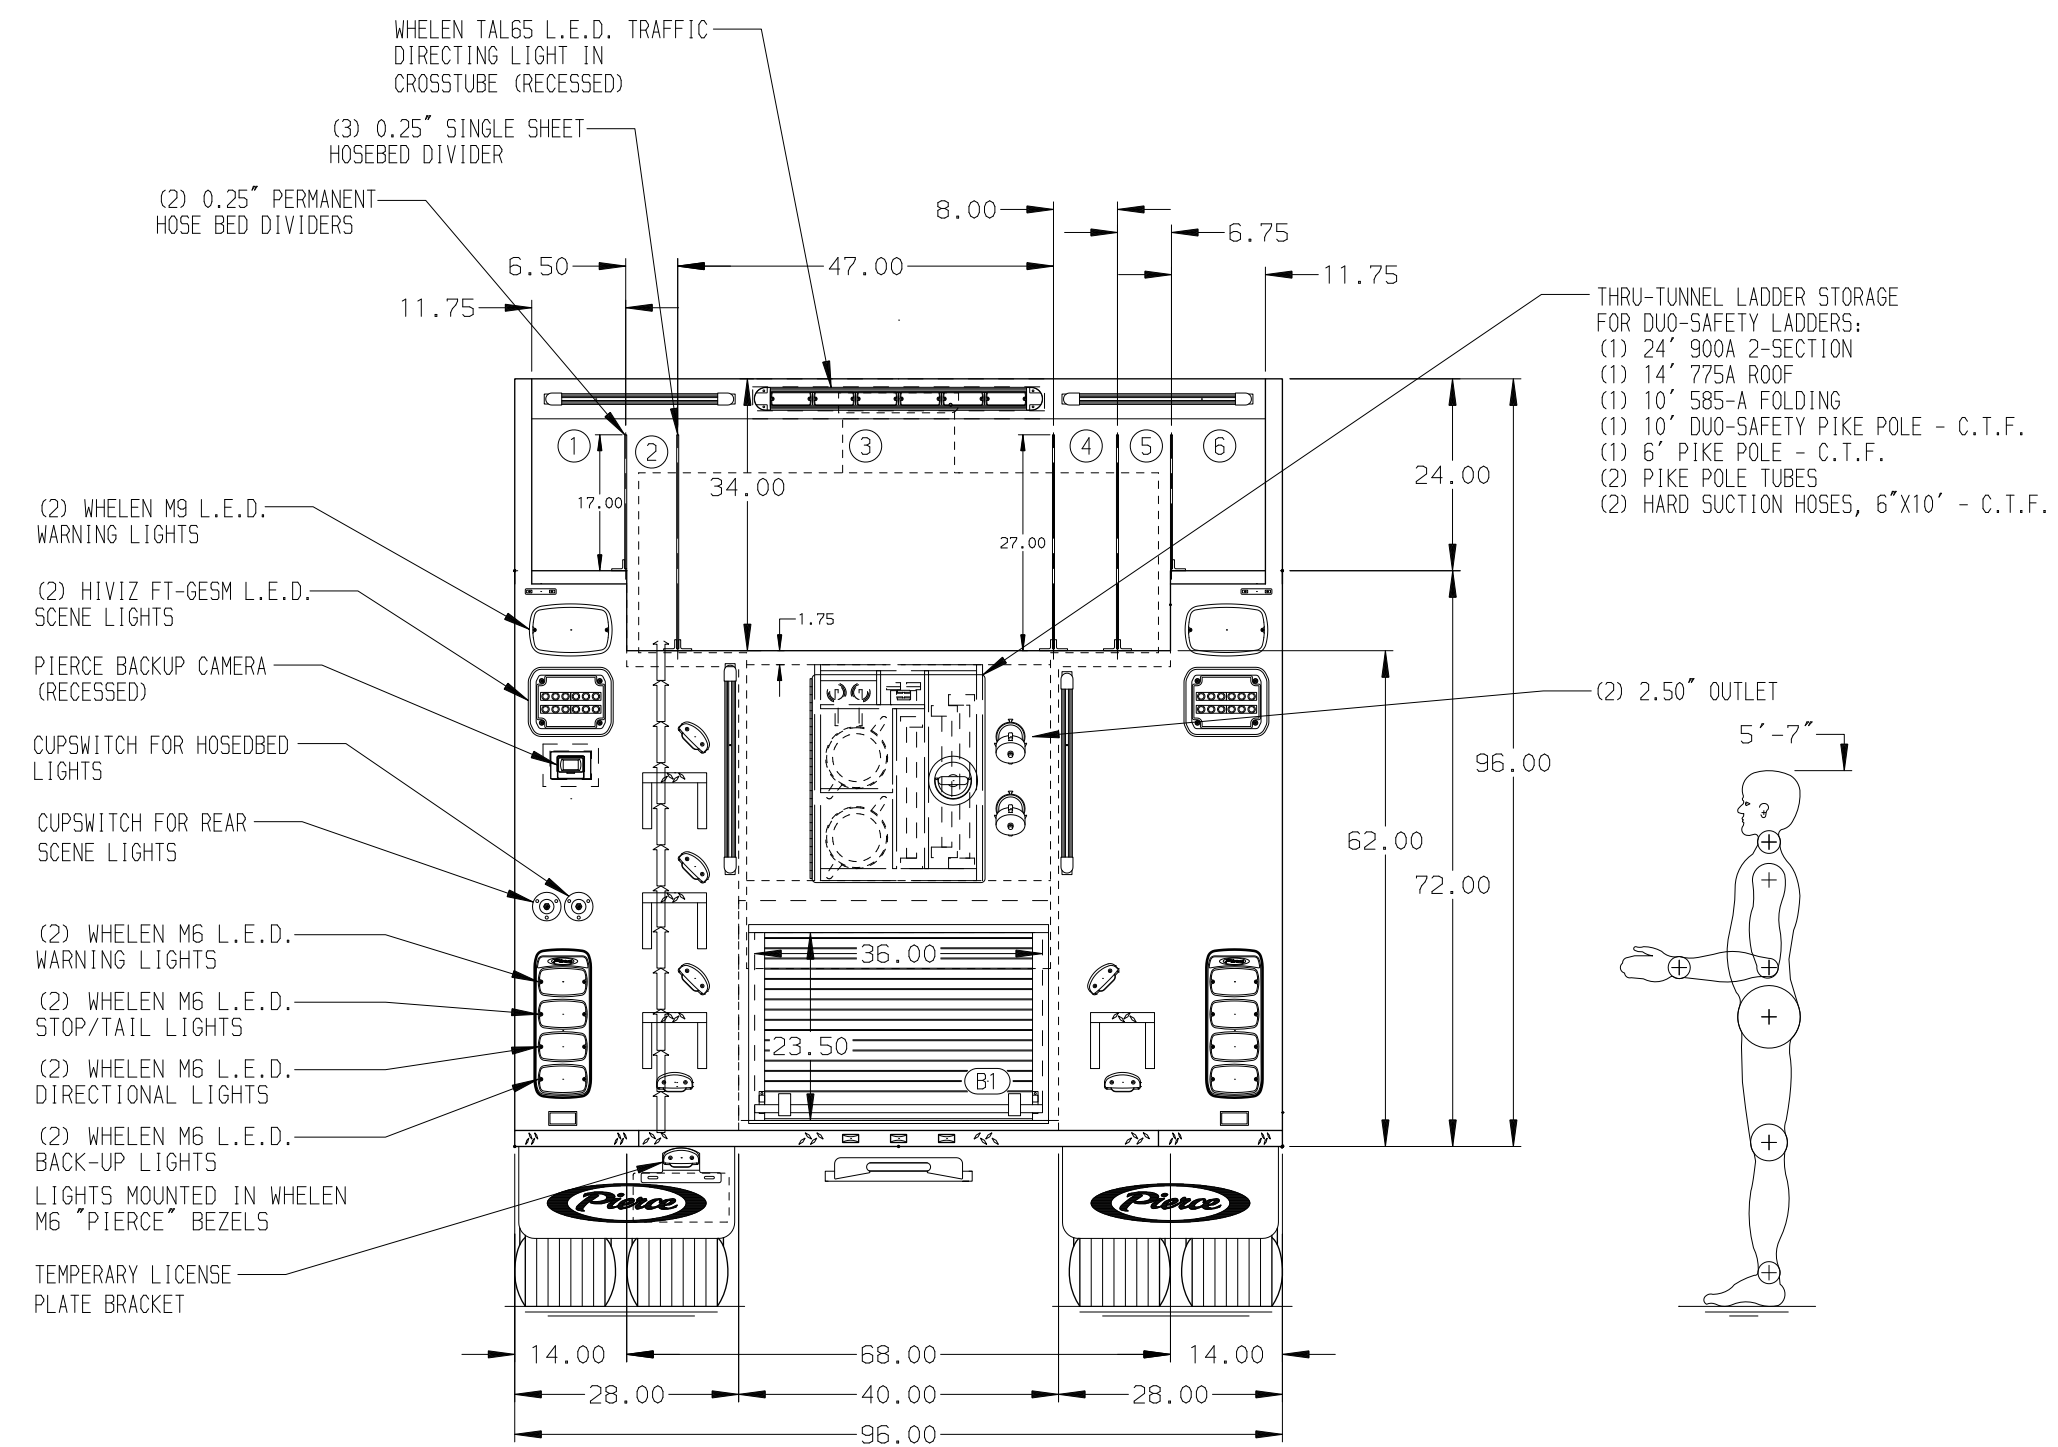

ALUMINUM BODY

FRONTAL IMPACT PROTECTION

NOTE

DIMENSIONS SHOWN ARE APPROXIMATE AND ARE SUBJECT TO MINOR DEVIATIONS AS MAY OCCUR OR BE NECESSARY IN CONSTRUCTION. MINOR DETAILS NOT SHOWN.

- BATTERY CHARGER LOCATED IN COMPARTMENT LS3, HIGH ON LEFT WALL
- BATTERY CHARGER INDICATOR LOCATED ON DRIVER'S SEAT RISER
- AIR COMPRESSOR LOCATED IN COMPARTMENT LS3, HIGH ON BACK WALL, LS

REV	DATE	BY	CH	SABER FR
23MAY25	VHO	DDR		
17APR25	VHO	DDR		
06DEC24	CDU	CDU		

TITLE	1500 GPM, 1000G WATER TANK 171" PUMPER, HARDWIRED
FOR	CEDARVILLE TOWNSHIP FIRE DEPARTMENT CEDERVILLE, OHIO
DWG NO.	40987AD

CHASSIS DATA	MAKE	PIERCE
MODEL		

JOB NO.	40987
SCALE	1:24
DATE	
DRAWN BY	SDR
CHECKED BY	CDU
SHEET SIZE	D
SHEET NO.	1 OF 1