

PUMPER BODY

Medium Aluminum 2nd Gen Pumper

CHASSIS

Saber FR Chassis

CHASSIS AXLE, FRONT, CUSTOM

18,000 Lb TAK-4 Axle

AXLE, REAR

24,000 Lb Dana Axle

ENGINE

450 HP Cummins L9 Engine

TRANSMISSION

Allison 6th Gen, 3000 EVS P

BUMPER

22" Extended Painted Steel

CAB

7000 Saber FR Cab

BODY

TOTAL TANK CAPACITY

750 Gallon New York Style Poly Tank

WATER CAPACITY

750 Gallons of Water

FOAM CELL CAPACITY

Foam Cell Not Required

COMPT, PUMPER, REAR

30.75" FF Double Door Rear Compt

COMPT, PUMPER, LEFT SIDE

145" Lap Full Height Front & Rear

COMPT, PUMPER, RIGHT SIDE

145" Lap Low

FIRE SUPPRESSION PUMPHOUSE

45" Control Zone Side Mount

PUMP

1500 GPM Waterous CX

CROSSLAY, 1.50"

1.50" Crosslays Not Required

CROSSLAYS, 2.50"

2.50" Crosslay Not Required

SPEEDLAYS

SpeedLays Not Required

GENERATOR

Generator Not Required

FOAM SYSTEM


Foam System Not Required

SAFETY

Side Roll and Frontal Impact Protection

NOTE

DIMENSIONS SHOWN ARE APPROXIMATE AND ARE SUBJECT TO MINOR DEVIATIONS AS MAY OCCUR OR BE NECESSARY IN CONSTRUCTION. MINOR DETAILS NOT SHOWN.

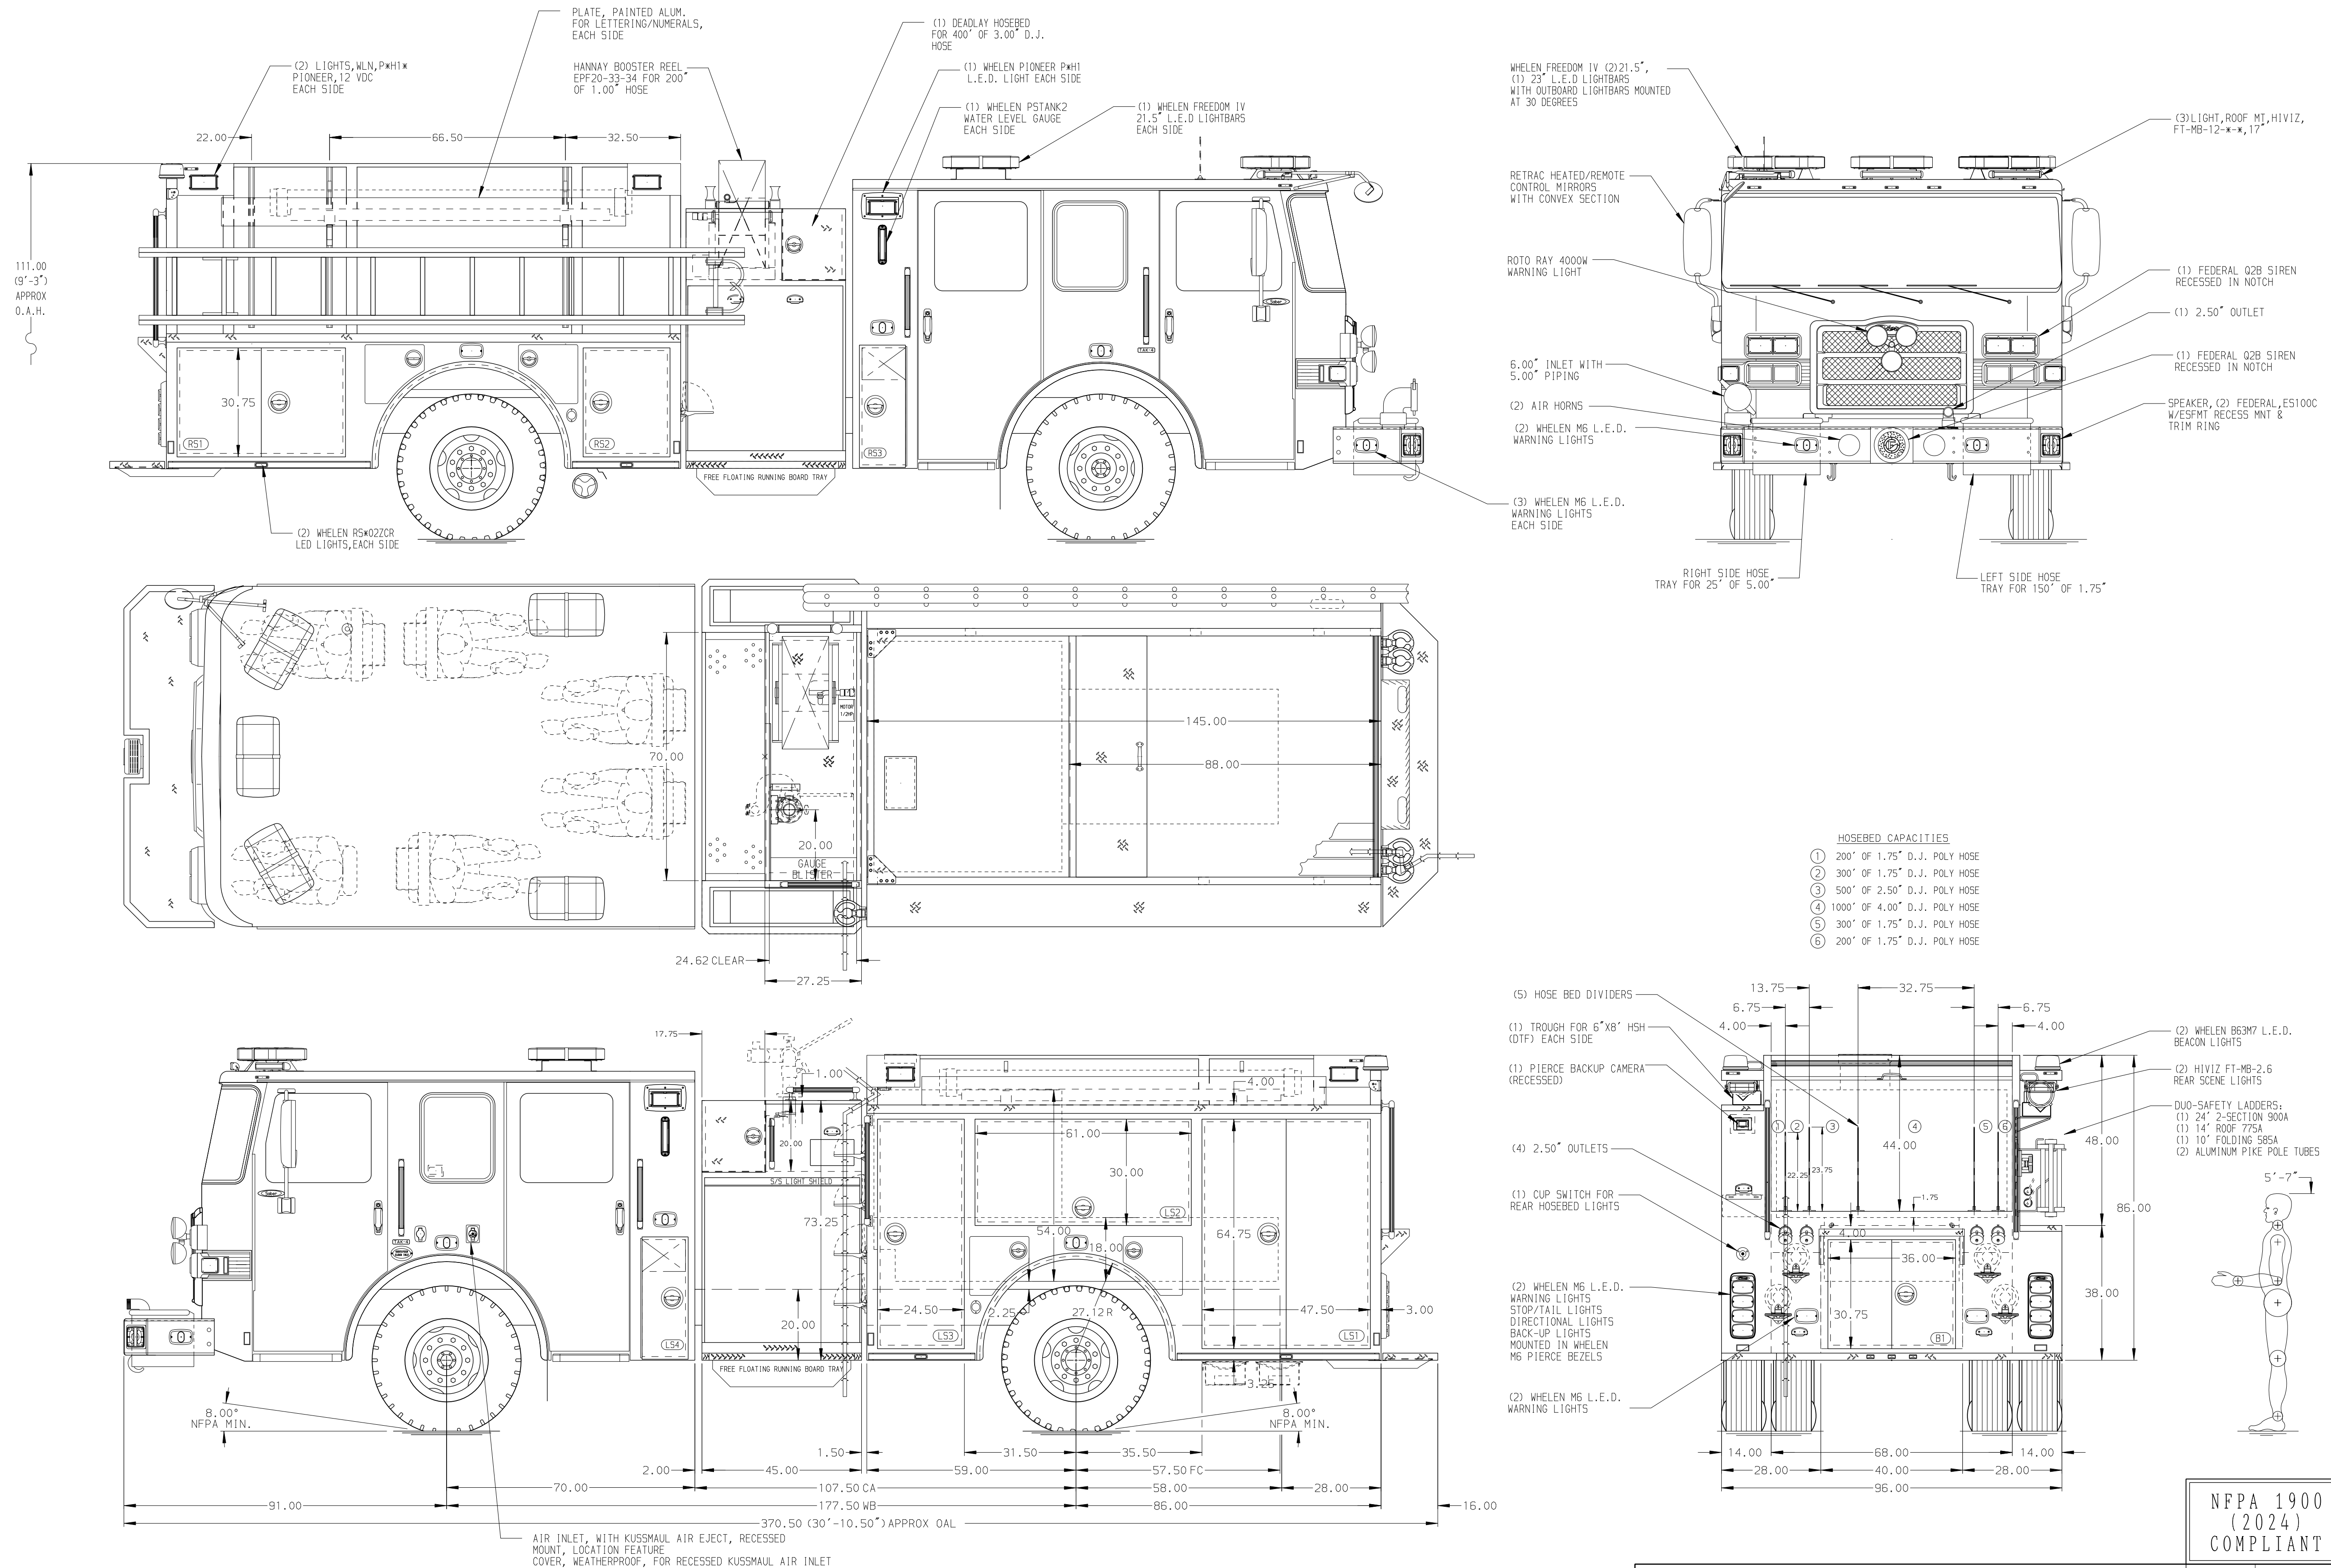

HOSEBED CAPACITIES

- 200' OF 1.75" D.J. POLY HOSE
- 300' OF 1.75" D.J. POLY HOSE
- 500' OF 2.50" D.J. POLY HOSE
- 1000' OF 4.00" D.J. POLY HOSE
- 300' OF 1.75" D.J. POLY HOSE
- 200' OF 1.75" D.J. POLY HOSE

NFPA 1900 (2024) COMPLIANT

| | | | |
|----------------------------------|--|-----------------------------------|--------|
| Pierce MANUFACTURING INC. | | JOB NO. | 41304 |
| | | SCALE | 1:24 |
| | | DATE | |
| | | DRAWN BY | KLE |
| | | CHECKED BY | MMF |
| | | SHEET SIZE | D |
| | | SHEET NO. | 1 OF 1 |
| TITLE | | Pierce Pumper Approval Packet | |
| FOR | | Seaford Volunteer Fire Department | |
| DWG NO. | | 41304AD | |

| REV | DATE | BY | CH | SABER FR |
|---------|------|-----|----|----------|
| 10AUG25 | WHO | CCS | | |
| 26JUN25 | ADP | CCS | | |