


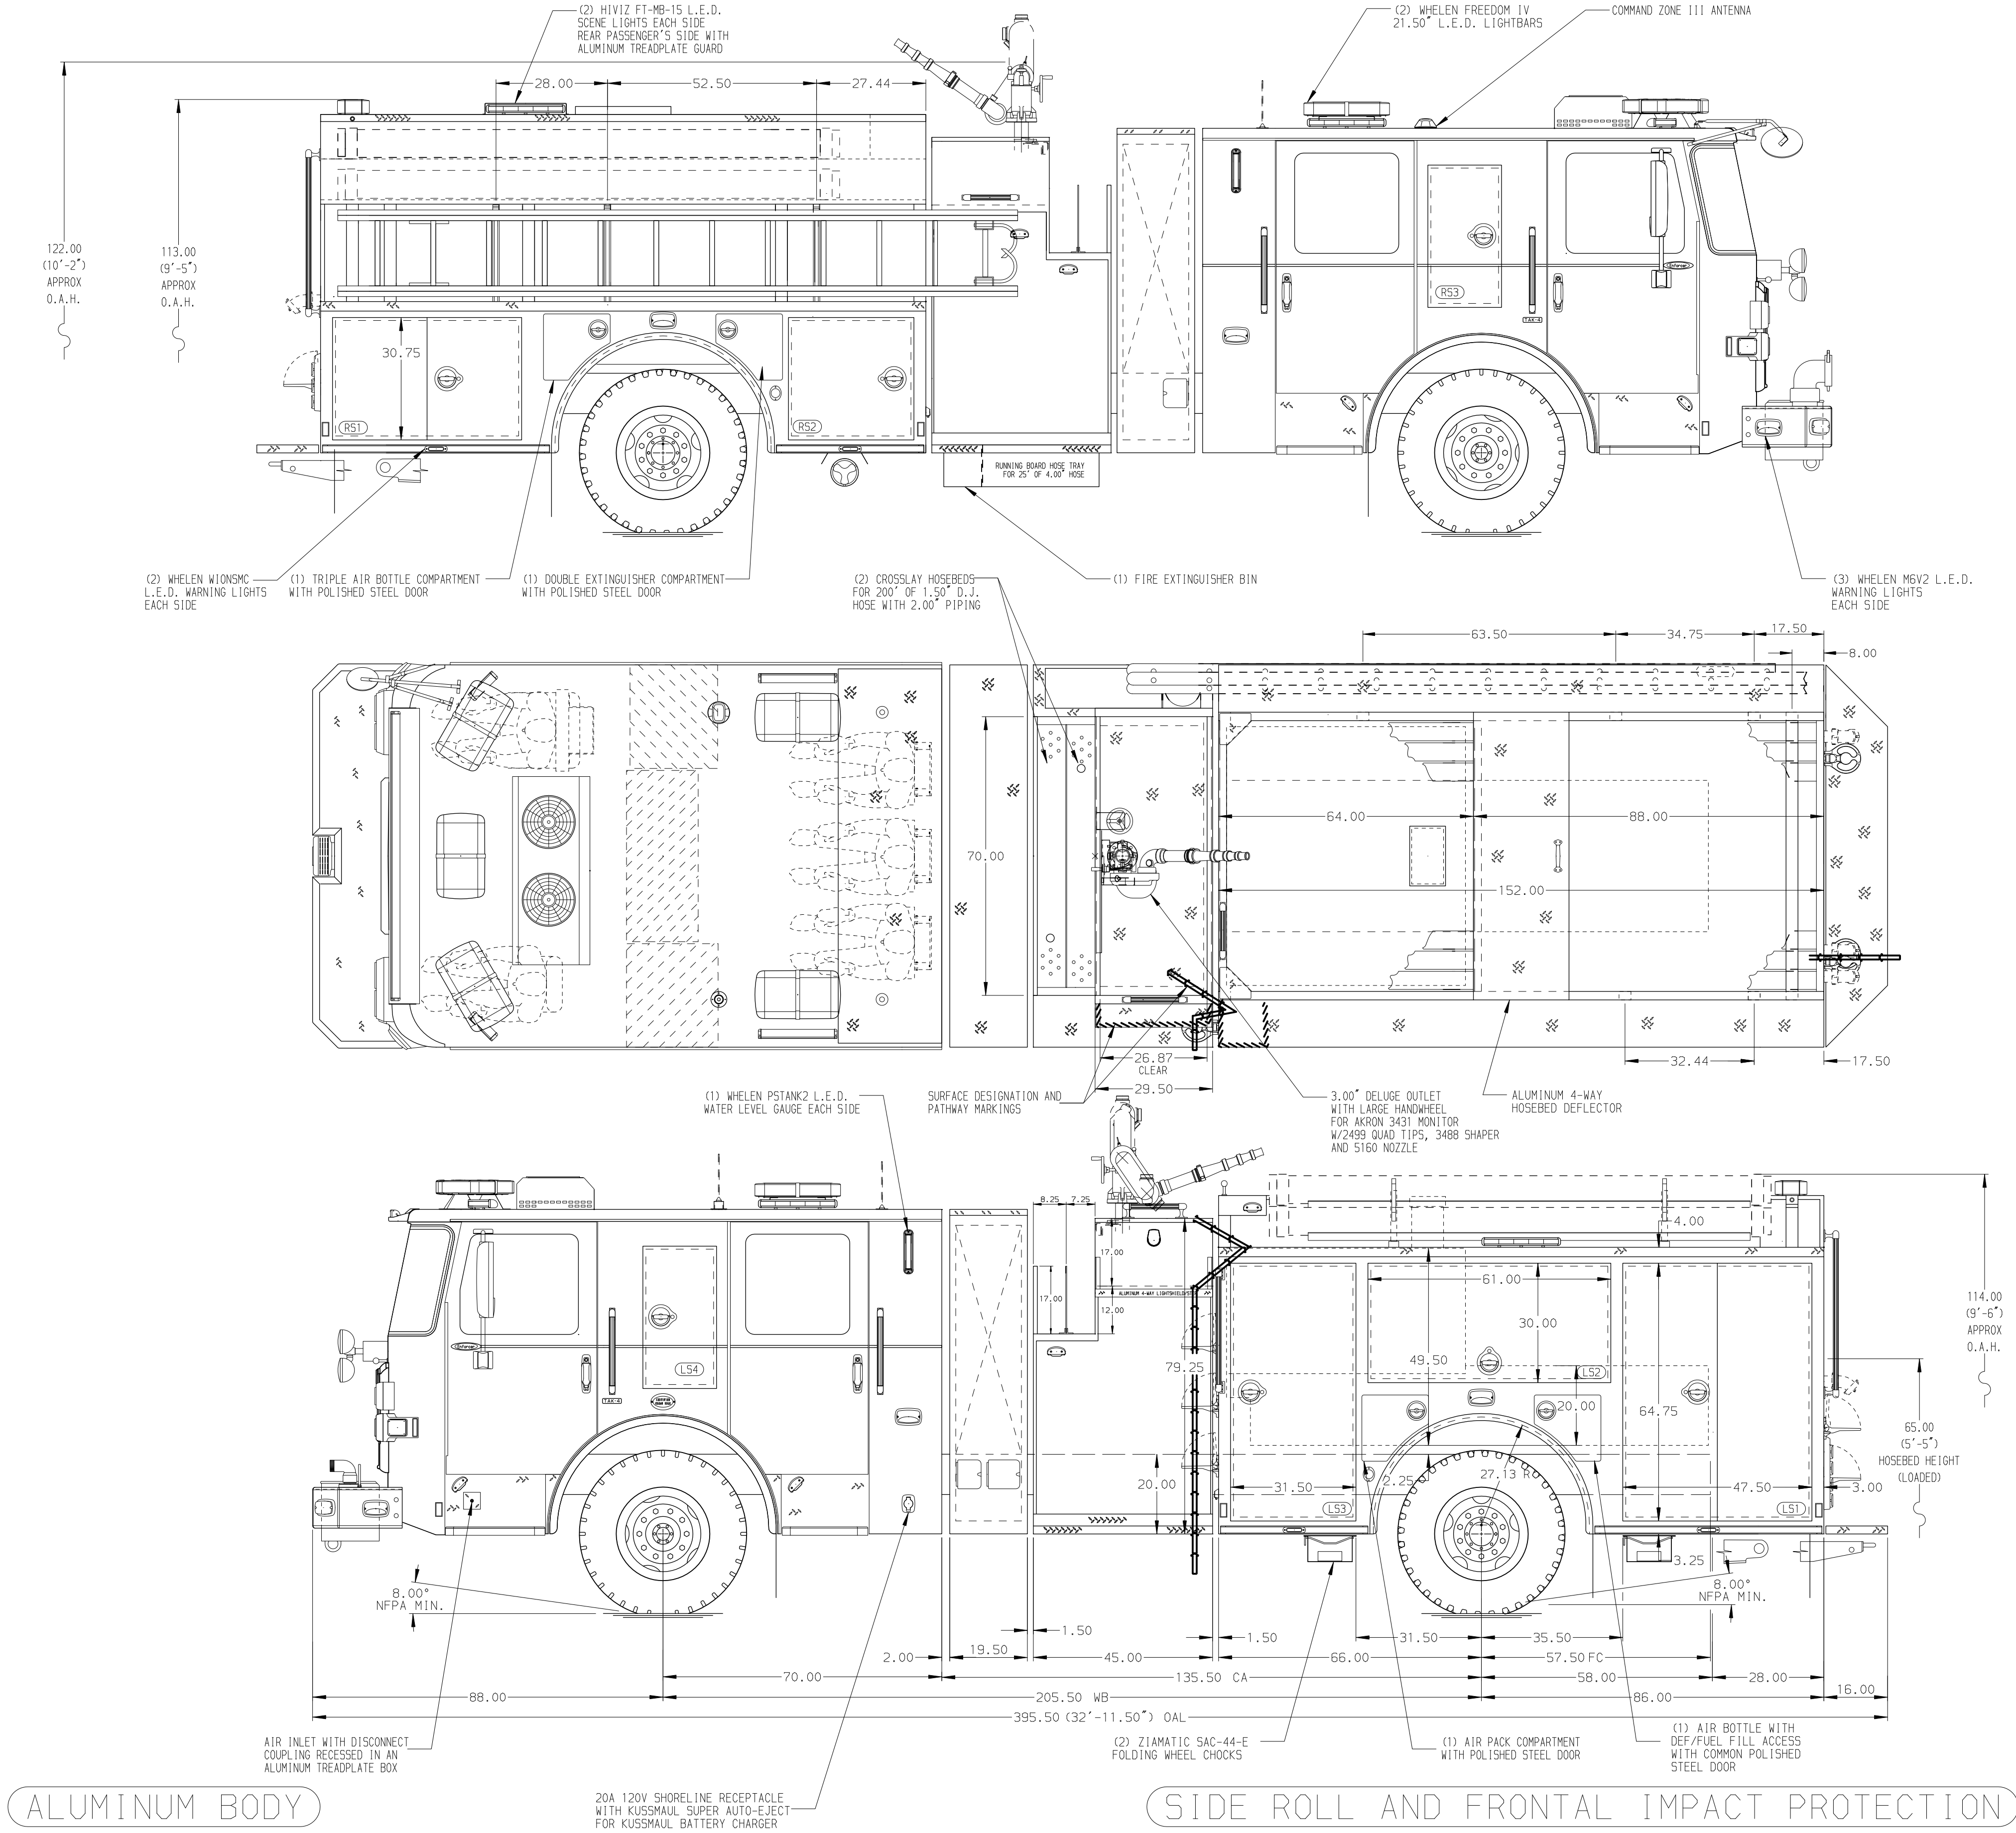

NOTE
DIMENSIONS SHOWN ARE APPROXIMATE AND ARE SUBJECT TO MINOR DEVIATIONS AS MAY OCCUR OR BE NECESSARY IN CONSTRUCTION. MINOR DETAILS NOT SHOWN.

- 1. PUMP PANEL DRAWING REQUIRED
- 2. ONSPOT AUTOMATIC TIRE CHAINS TO BE PROVIDED AT REAR
- 3. BATTERY CHARGER LOCATED BEHIND DRIVER'S SEAT
- 4. BATTERY CHARGER INDICATOR LOCATED ON DRIVER'S SEAT RISER
- 5. ONE 120V NEMA DUPLEX RECEPTACLE IN EACH EMS COMPARTMENT

SIDE ROLL AND FRONTAL IMPACT PROTECTION

REV	DATE	BY	CH
10MAR25	BTH	CLM	
17JAN25	BTH	CLM	



TITLE	1500 GPM, 750G WATER TANK 152" 2G PUMPER, MUX, VHV
FOR	FREDERICK COUNTY FREDERICK, MARYLAND
DWG NO.	43399AD-SH1

**NFPA 1900
(2024)
COMPLIANT**

JOB NO.	43399
SCALE	DATE
1:24	
DRAWN BY	DATE
JJB	16AUG24
CHECKED BY	DATE
CLM	16AUG24
SHEET SIZE	SHEET NO.
D	1 OF 2