

# PUMPER BODY

Medium Aluminum 2nd Gen Pumper

## CHASSIS

Saber FR Chassis

## CHASSIS AXLE, FRONT, CUSTOM

18,000 Lb Dana Axle

## AXLE, REAR

24,000 Lb Dana Axle

## ENGINE

450 HP Cummins L9 Engine

## TRANSMISSION

Allison 6th Gen, 3000 EVS P

## BUMPER

10" Extended Painted Steel

## CAB

7010 Saber FR Cab

## BODY

### TOTAL TANK CAPACITY

750 Gallon New York Style Poly Tank

### WATER CAPACITY

750 Gallons of Water

### FOAM CELL CAPACITY

Foam Cell Not Required

### COMPT, PUMPER, REAR

30.75" FF RollUp Rear Compt

### COMPT, PUMPER, LEFT SIDE

152" Lap Full Height Front & Rear FDLER

### COMPT, PUMPER, RIGHT SIDE

152" Lap Low FDLER

## FIRE SUPPRESSION PUMPHOUSE

45" Control Zone Side Mount

### PUMP

1500 GPM Waterous CSU

### CROSSLAYS, 1.50"

(2) 1.50" Standard Capacity

### CROSSLAYS, 2.50"

(1) 2.50" Standard Capacity

### SPEEDLAYS

SpeedLays Not Required

### GENERATOR

Generator Not Required


### FOAM SYSTEM

Foam System Not Required

## SAFETY

### NOTE

DIMENSIONS SHOWN ARE APPROXIMATE AND ARE SUBJECT TO MINOR DEVIATIONS AS MAY OCCUR OR BE NECESSARY IN CONSTRUCTION. MINOR DETAILS NOT SHOWN.

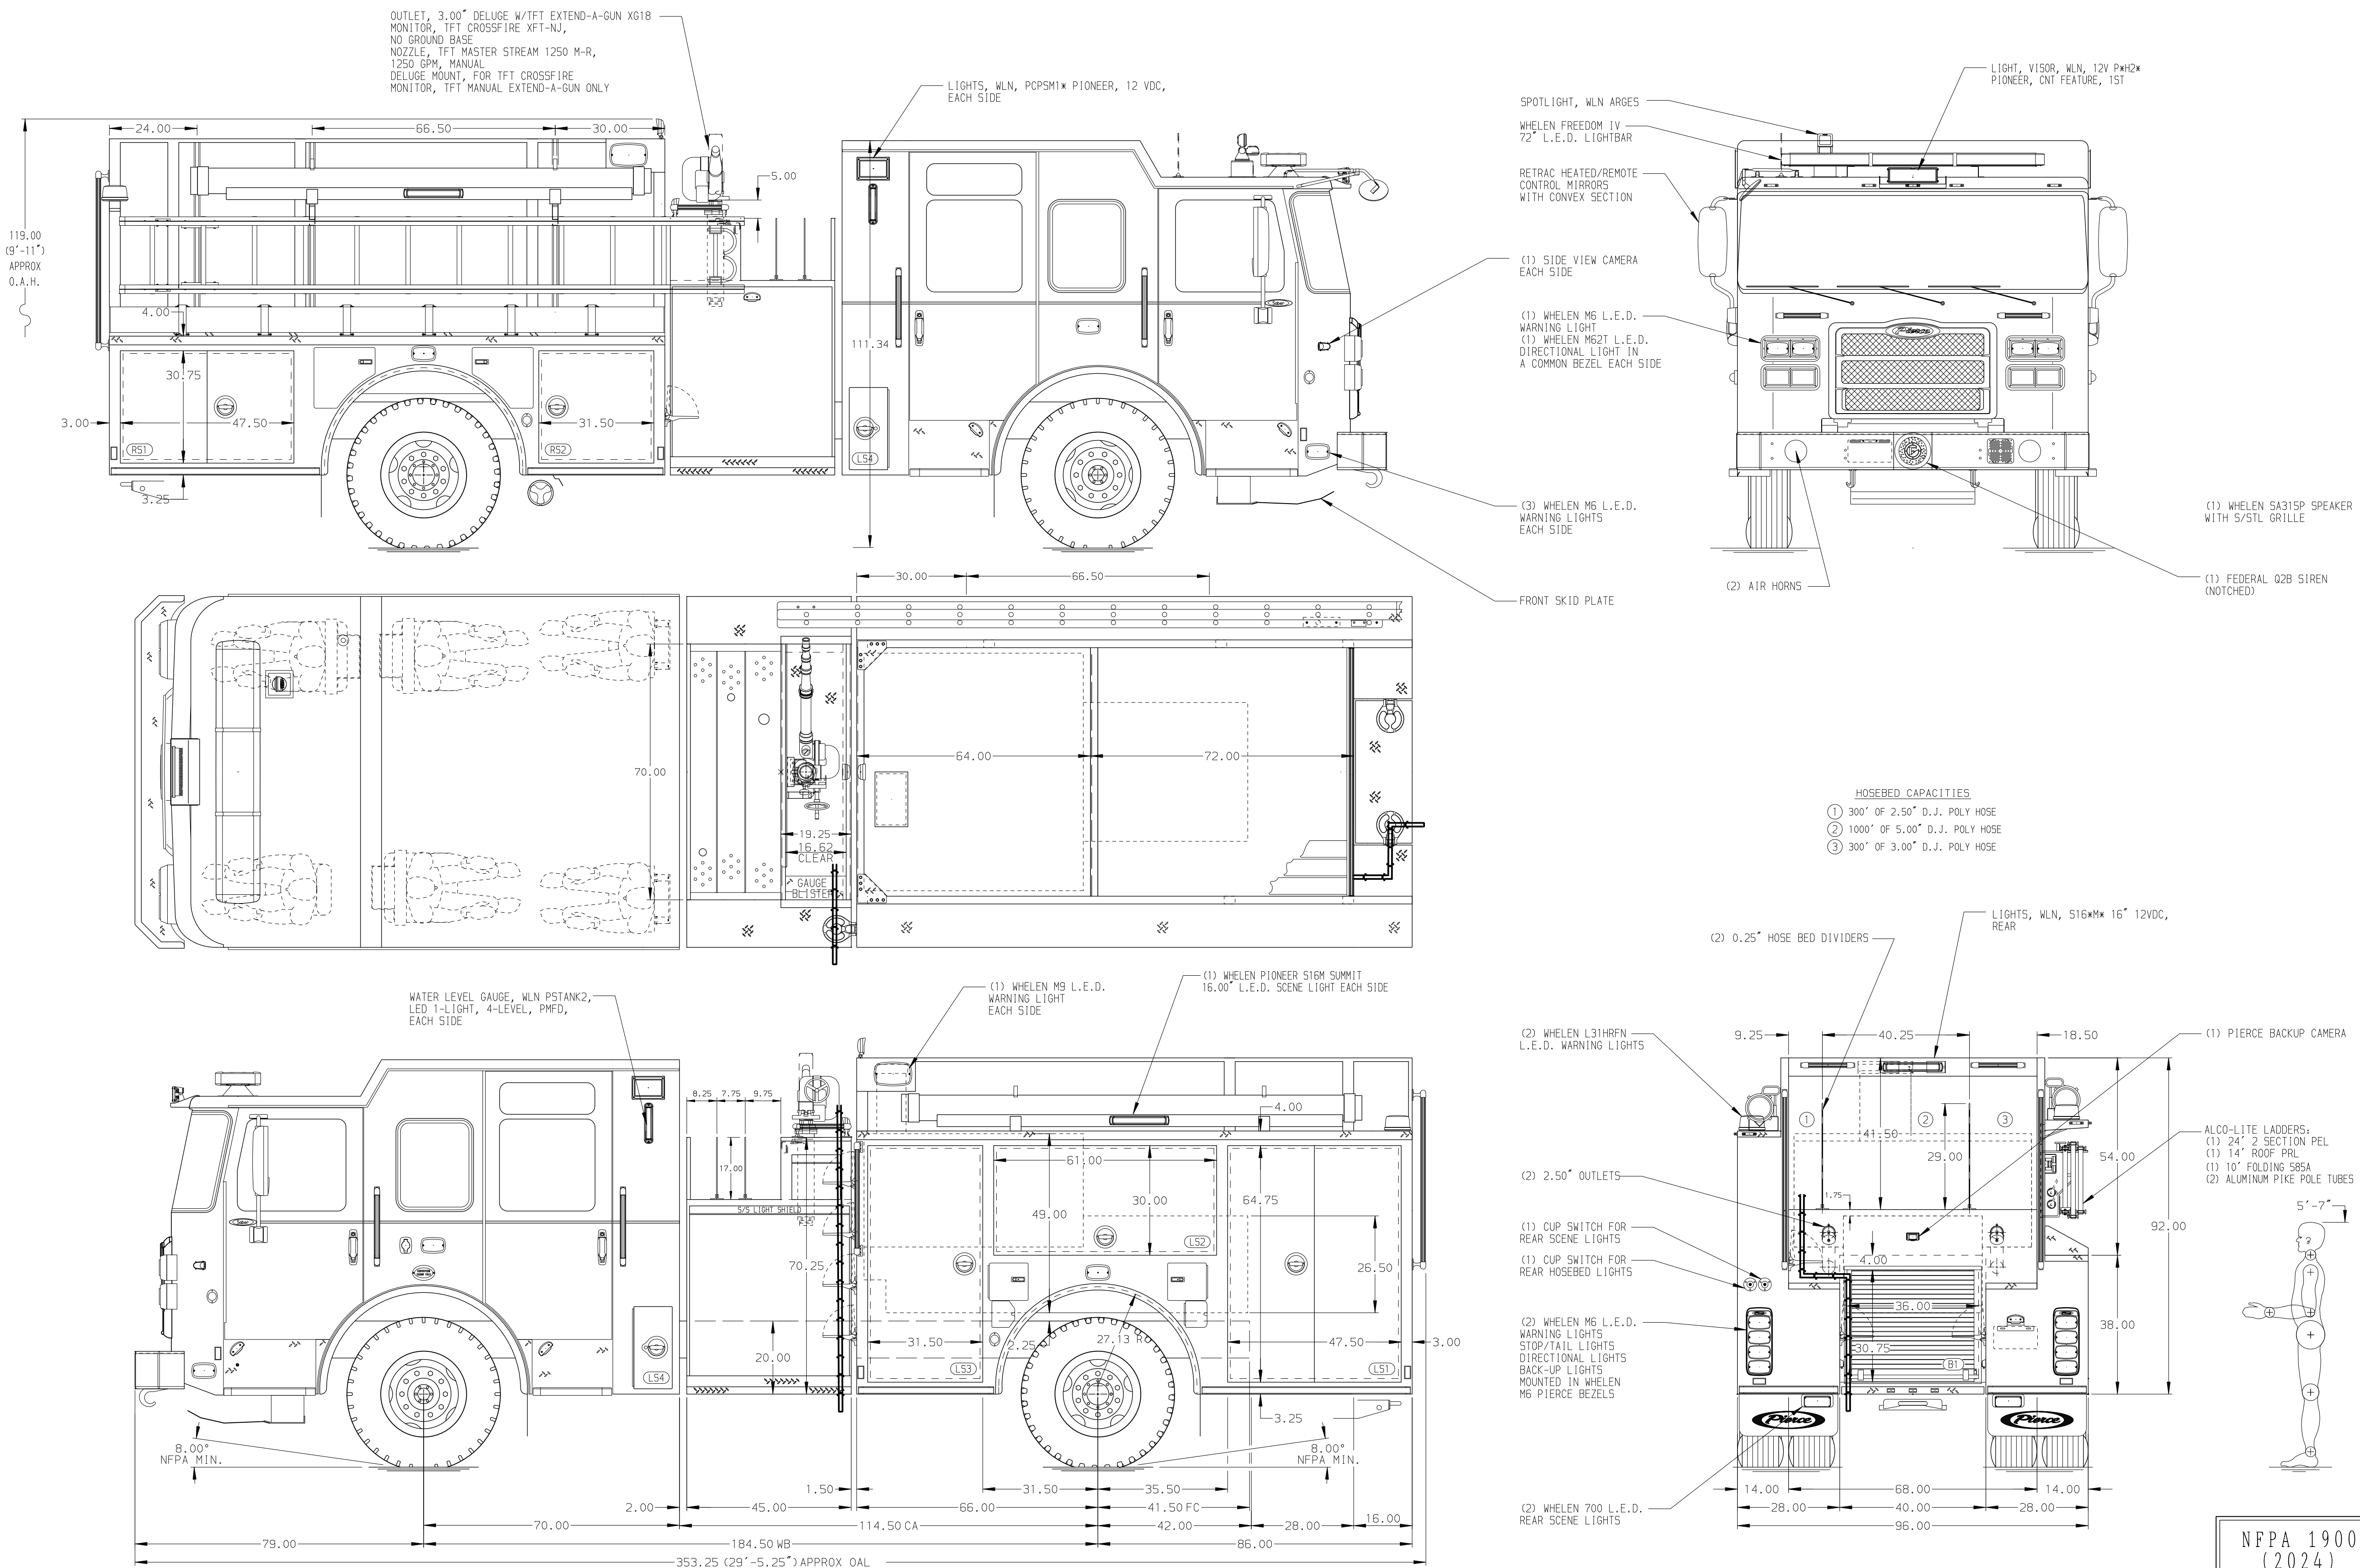

### CUSTOMER APPROVAL

APPROVED BY: \_\_\_\_\_  
DATE: \_\_\_\_\_



CHASSIS DATA	TITLE	Pierce Pumper Approval Drawing
MAKE	FOR	Haverhill Fire Department
PIERCE	MODEL	
15SEP25	WHO	CGA
REV	DATE	BY
		CH
SABER FR	DWG NO.	44019AD

JOB NO.	44019
SCALE	DATE
1:24	
DRAWN BY	03JUN25
MMF	
CHECKED BY	4JUN25
AMI	
SHEET SIZE	SHEET NO.
D	1 OF 1

NFPA 1900 (2024) COMPLIANT

JOB NO.	44019
SCALE	DATE
1:24	
DRAWN BY	03JUN25
MMF	
CHECKED BY	4JUN25
AMI	
SHEET SIZE	SHEET NO.
D	1 OF 1