


PUMPER BODY Long Aluminum 2nd Gen Pumper CHASSIS Enforcer Chassis
CHASSIS AXLE, FRONT, CUSTOM 18,000 Lb Meritor Axle AXLE, REAR 24,000 Lb Meritor Axle ENGINE 400 HP Cummins L9 Engine TRANSMISSION Allison 5th Gen, 3000 EVS P BUMPER 22" Extended Steel Painted CAB 7010 Enforcer Cab
BODY WATER TANK 500 Gallon Poly Water Tank COMPT, PUMPER, REAR 37.75" FF RollUp Rear Compt
COMPT, PUMPER, DRIVER SIDE 161" RollUp Full Height Front & Rear FDLER Special Depth Upper COMPT, PUMPER PASS. SIDE 161" RollUp Full Height Front & Rear FDLER Special Depth Upper
FIRE SUPPRESSION PUMPHOUSE 45" Control Zone Side Mount PUMP 1750 GPM Waterous CMU CROSSLAYS, 1.50" (2) 1.50" Standard Capacity CROSSLAYS, 2.50" 2.50" Crosslays Not Required SPEEDLAYS Speedlays Not Required GENERATOR Generator Not Required Foam System Foam System Not Required Foam Cell Foam Cell Not Required

NOTE
DIMENSIONS SHOWN ARE APPROXIMATE
AND ARE SUBJECT TO MINOR DEVIATIONS
AS MAY OCCUR OR BE NECESSARY IN
CONSTRUCTION.
MINOR DETAILS NOT SHOWN.

- VOEL LUBE SYSTEM PUMP LOCATED PER SHOP ORDER
- ALUMINUM TREADPLATE EXTERIOR REAR WALL OF CAB
- 5/STL SCUFFPLATE ON EACH CAB DOOR JAMB
- MOUNTING BASE FOR ANTENNA LOCATED PER SHOP ORDER
- BATTERY CHARGER LOCATED BEHIND DRIVER'S SEAT
- BATTERY CHARGE INDICATOR LOCATED NEAR D.S. SEAT RISER WITH BRACKET
- PERIMETER SCENE LIGHTS LOCATED PER SHOP ORDER
- DRIP PAN GUARD FOR ROLL-UP DOOR LOCATED D1,D2,D3,P1,P2,P3,R1
- PIERCE L.E.D. DUAL COMPARTMENT LIGHT STRIPS LOCATED PER SHOP ORDER
- SHELF TRACKS LOCATED IN COMPARTMENTS D1,D2,D3,P1,P2,P3,R1

- ONE FULL WIDTH/DEPTH PAINTED ADJUSTABLE SHELF IN COMPARTMENTS D2,P2,R1
- TWO FULL WIDTH/DEPTH PAINTED ADJUSTABLE SHELVES IN COMPARTMENTS D1,P1,P3
- THREE FULL WIDTH/DEPTH PAINTED ADJUSTABLE SHELVES IN COMPARTMENT D3
- PARTITION BETWEEN COMPARTMENTS D1/R1 AND P1/R1
- ONE VERTICAL PARTITION IN COMPARTMENT D1,D3
- THREE ADJUSTABLE VERTICAL PARTITIONS IN COMPARTMENT D1
- ONE POLY MOUNTING BOARD LOCATED IN COMPARTMENT P2, FIVE IN D3
- ALL FOLDING STEPS TO BE TRIDENT WITH INTEGRATED L.E.D. LIGHT UNLESS SPECIFIED
- (1) 120V 4-PLACE RECEPTACLE LOCATED IN EMS COMPARTMENT
- AIR INLET WITH DISCONNECT COUPLING ON D.S. PUMP PANEL

- AIR OUTLET WITH SHUT OFF VALVE LOCATED ON D.S. PUMP PANEL
- TWO POLY TOOL BOXES LOCATED IN COMPARTMENT P2

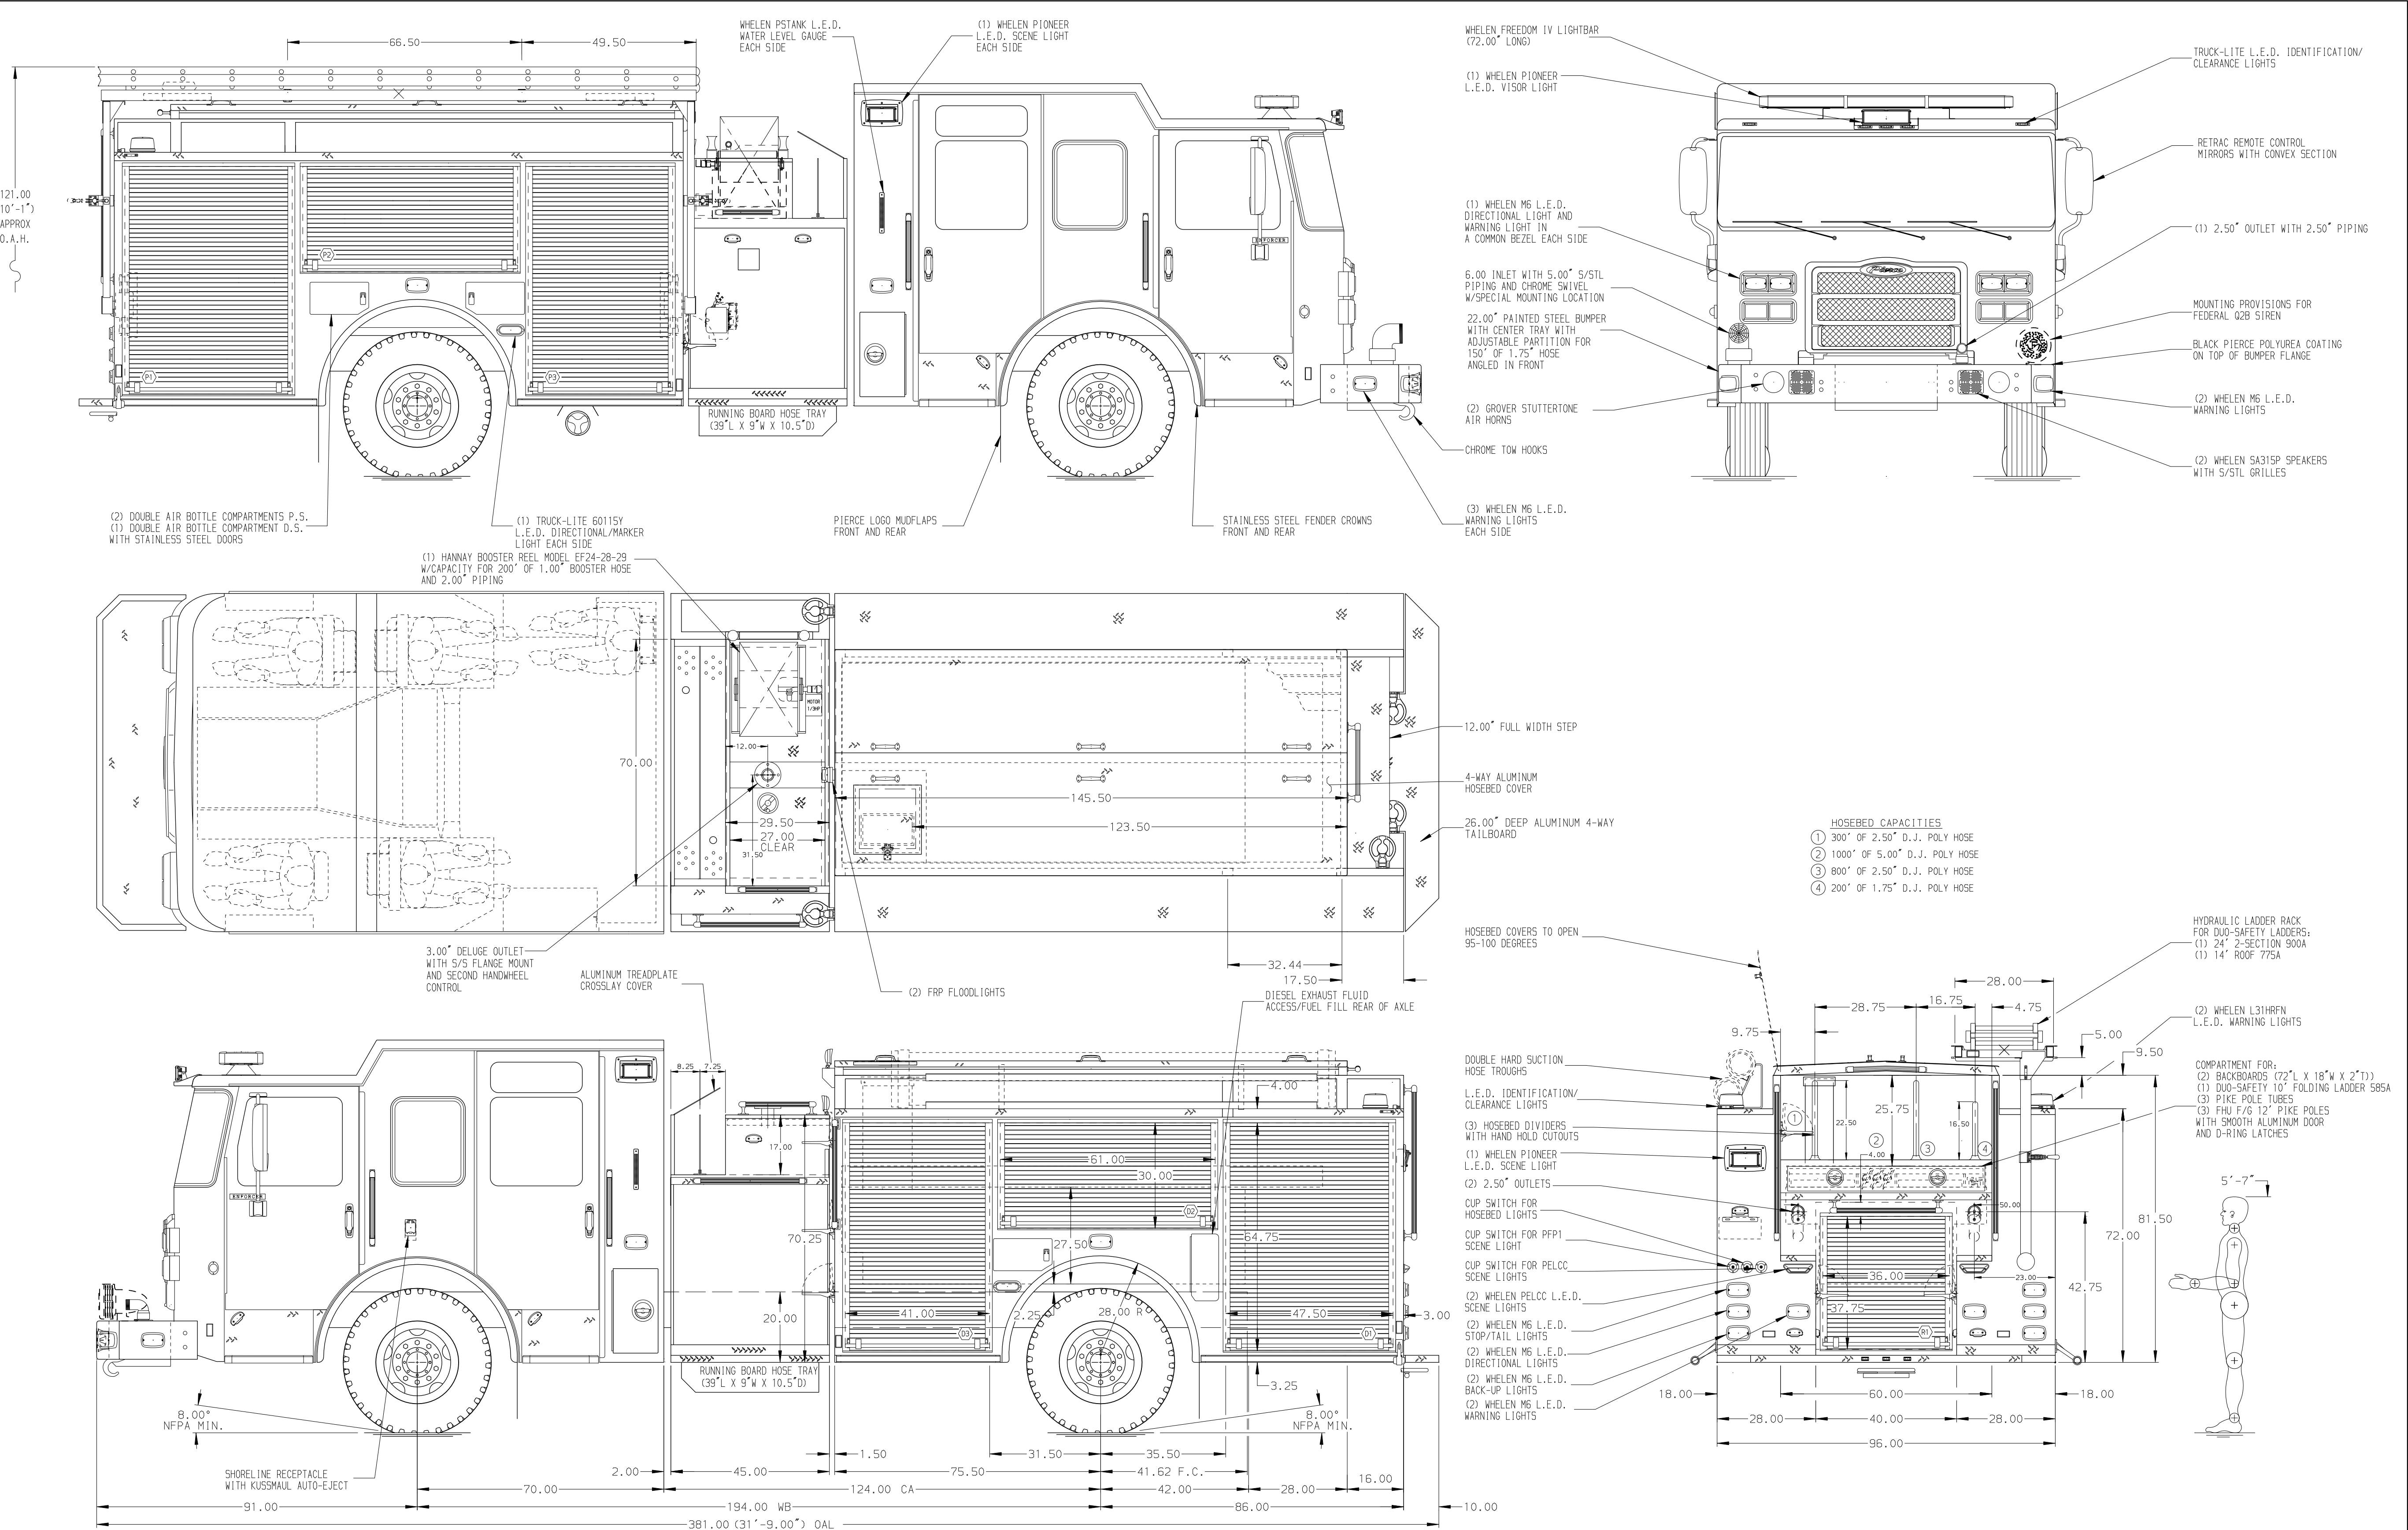

CUSTOMER APPROVAL

APPROVED BY: _____
DATE: _____

				CHASSIS DATA
				MAKE
				PIERCE
				MODEL
REV	DATE	BY	CH	ENFORCER

 MANUFACTURING INC.		JOB NO.	30875 01-02
		SCALE	DATE
		DRAWN BY	17NOV16
		COL	
		CHECKED BY	21NOV16
		JGO	
		SHEET SIZE	SHEET NO.
		D	1 OF 1

TITLE 1750-D-500 GALLON POLY, 161" FDLER, SPCL DEPTH
(2)XLAYS, DELUGE, BOOSTER REEL, HYD. LADDER RACK
FOR JACKSONVILLE FIRE AND RESCUE
JACKSONVILLE, FLORIDA
DWG NO. 30875AD